


- NOTES:
- ROUTE ACCESS ROAD AROUND POWER POLES. MAINTAIN 12' WIDE ROAD WHEN ROUTING AROUND POLES.
  - STRIP 2" OF SOIL AND VEGETATION, SHAPE SUBGRADE TO LINES AND GRADES INDICATED. PROFFROLL SUBGRADE TO IDENTIFY SOFTSPOTS OR VEGETABLE MATERIAL. MIRIFI 400X, OR EQUAL, FOUNDATION FABRIC SHALL BE PLACED OVER SOFT SPOTS.

**GRAVEL ACCESS ROAD** A  
1/4"=1'-0" B5, B6, B7, B8, B9



NO. BY	CK	APP
REVISIONS AND RECORD OF ISSUE		
DATE	REVISIONS AND RECORD OF ISSUE	
CYNET ID: 97515-310-C-700001HSM	NO. BY	CK
SAVED: 3/16/2002 1:52:52 PM	NO. BY	CK
DWG VER #: 1-12	NO. BY	CK
PLOTTED: 04/30/2002 3:15:47 PM	NO. BY	CK
USERS: HAL32202	NO. BY	CK
SW: ACD 20001	NO. BY	CK

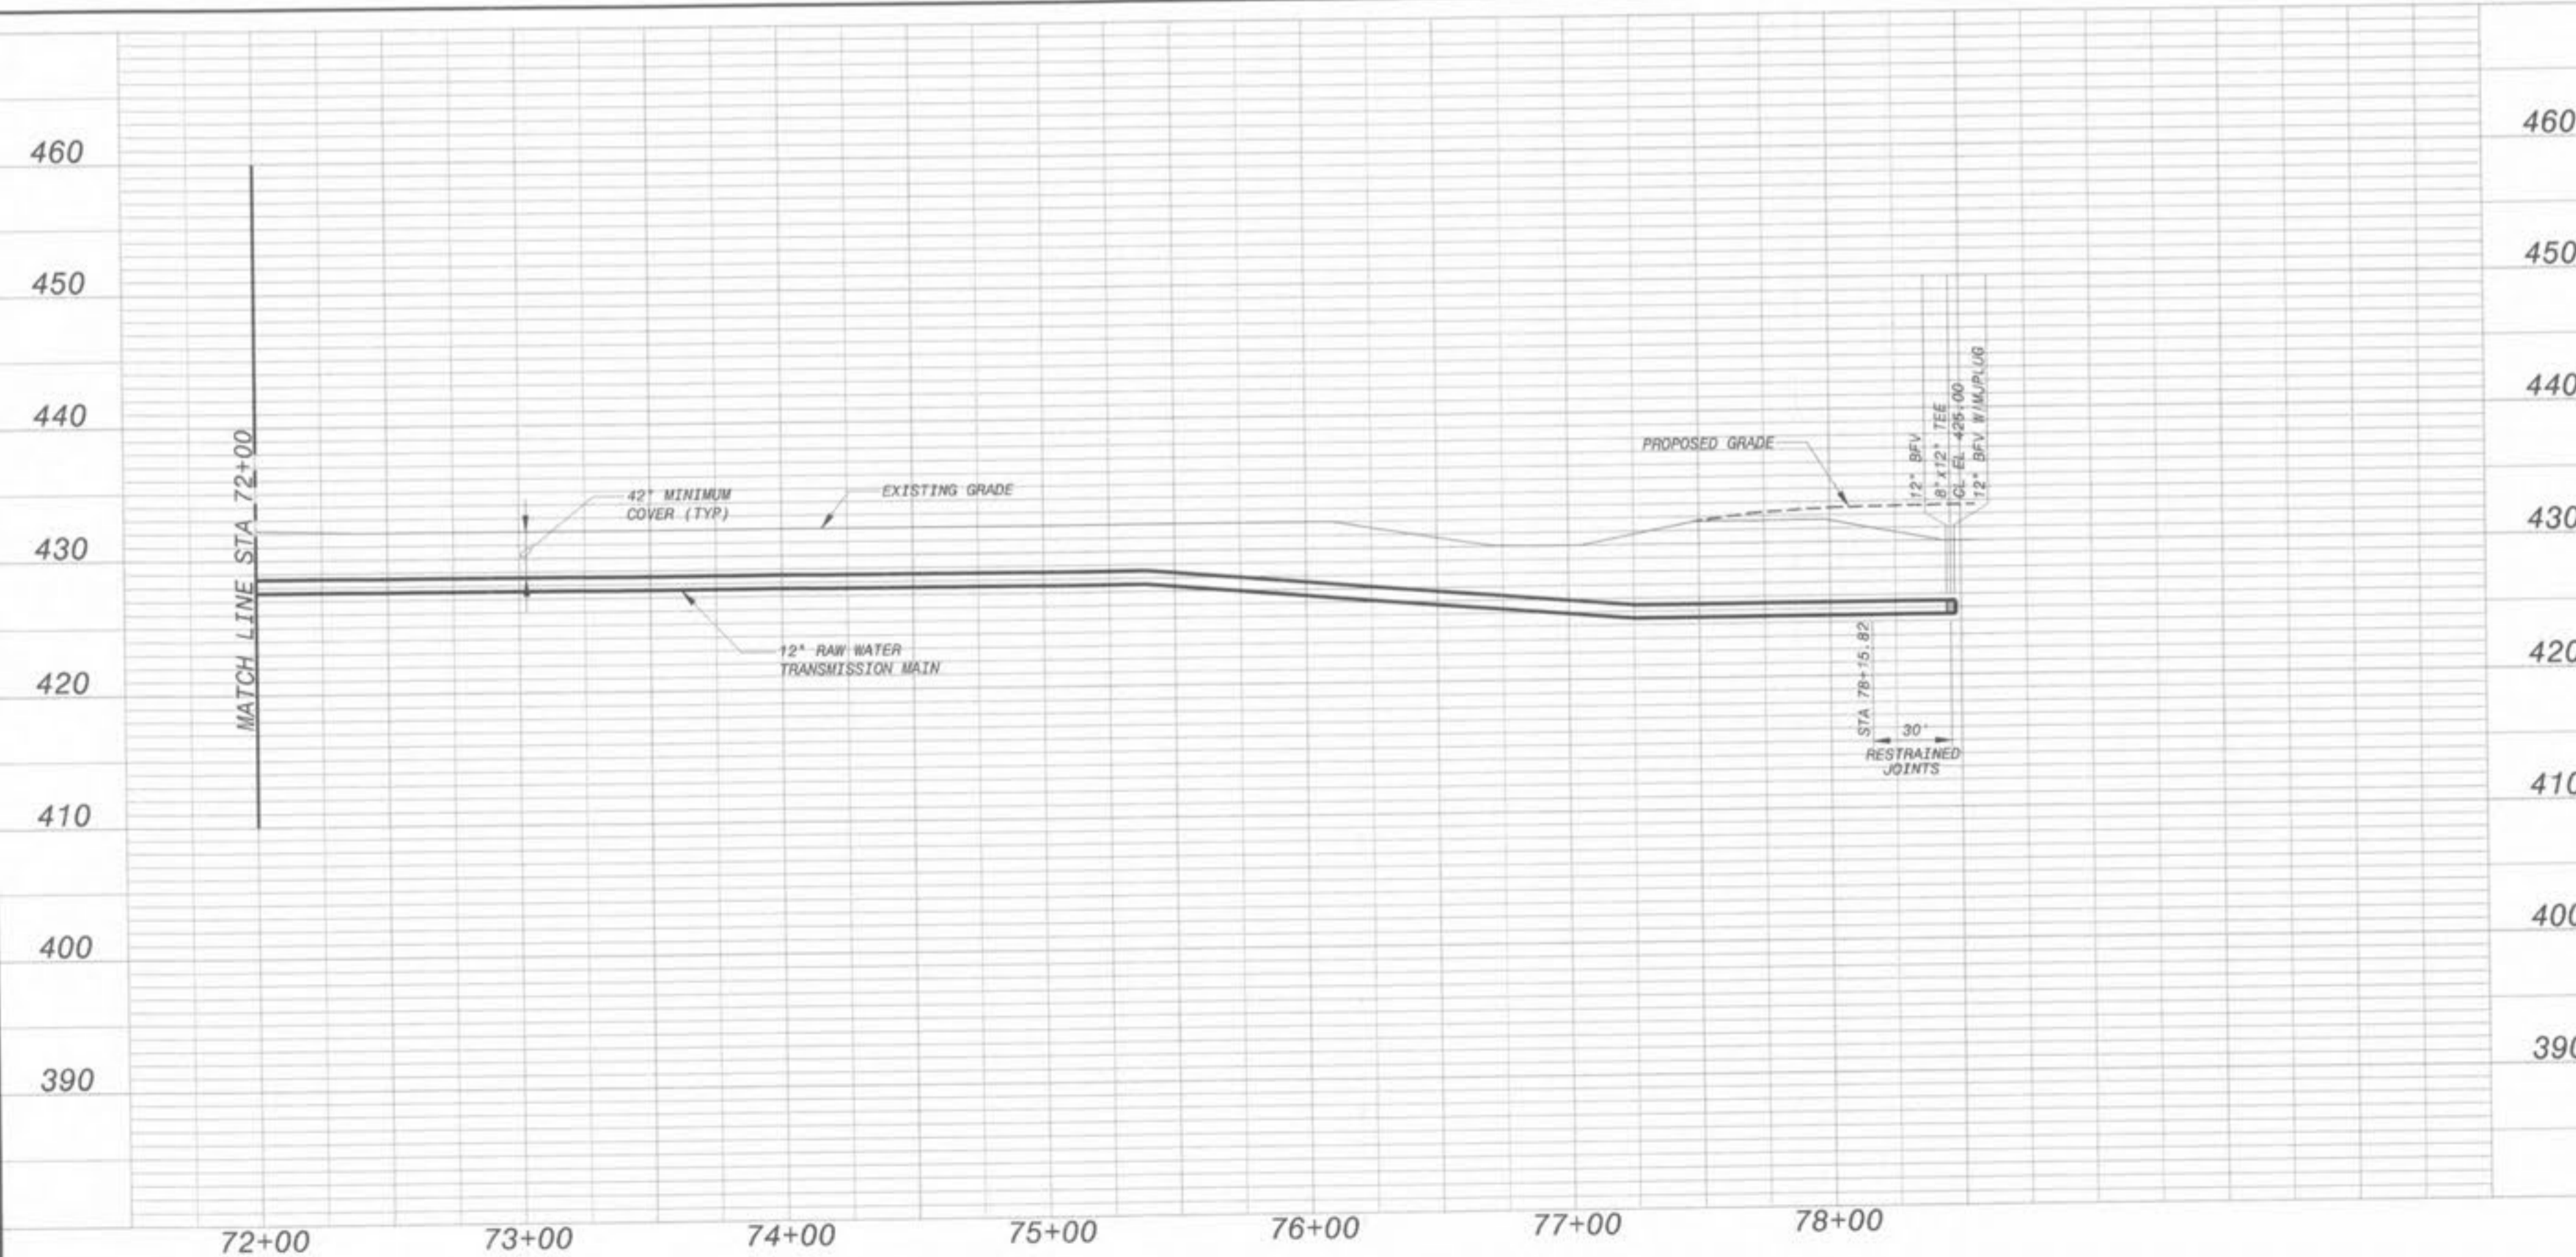

CITY OF O'FALLON, MISSOURI  
WELL FIELD AND RAW WATER  
TRANSMISSION MAIN

STA 72+00 TO EOP

DESIGNED: BPF  
 DETAILED: DPH, CSA  
 CHECKED: RFS  
 APPROVED: KMN  
 DATE: 3-7-02

PROJECT NO.

97515

B9

SHEET  
10 OF 15