


*Richard D. Long*

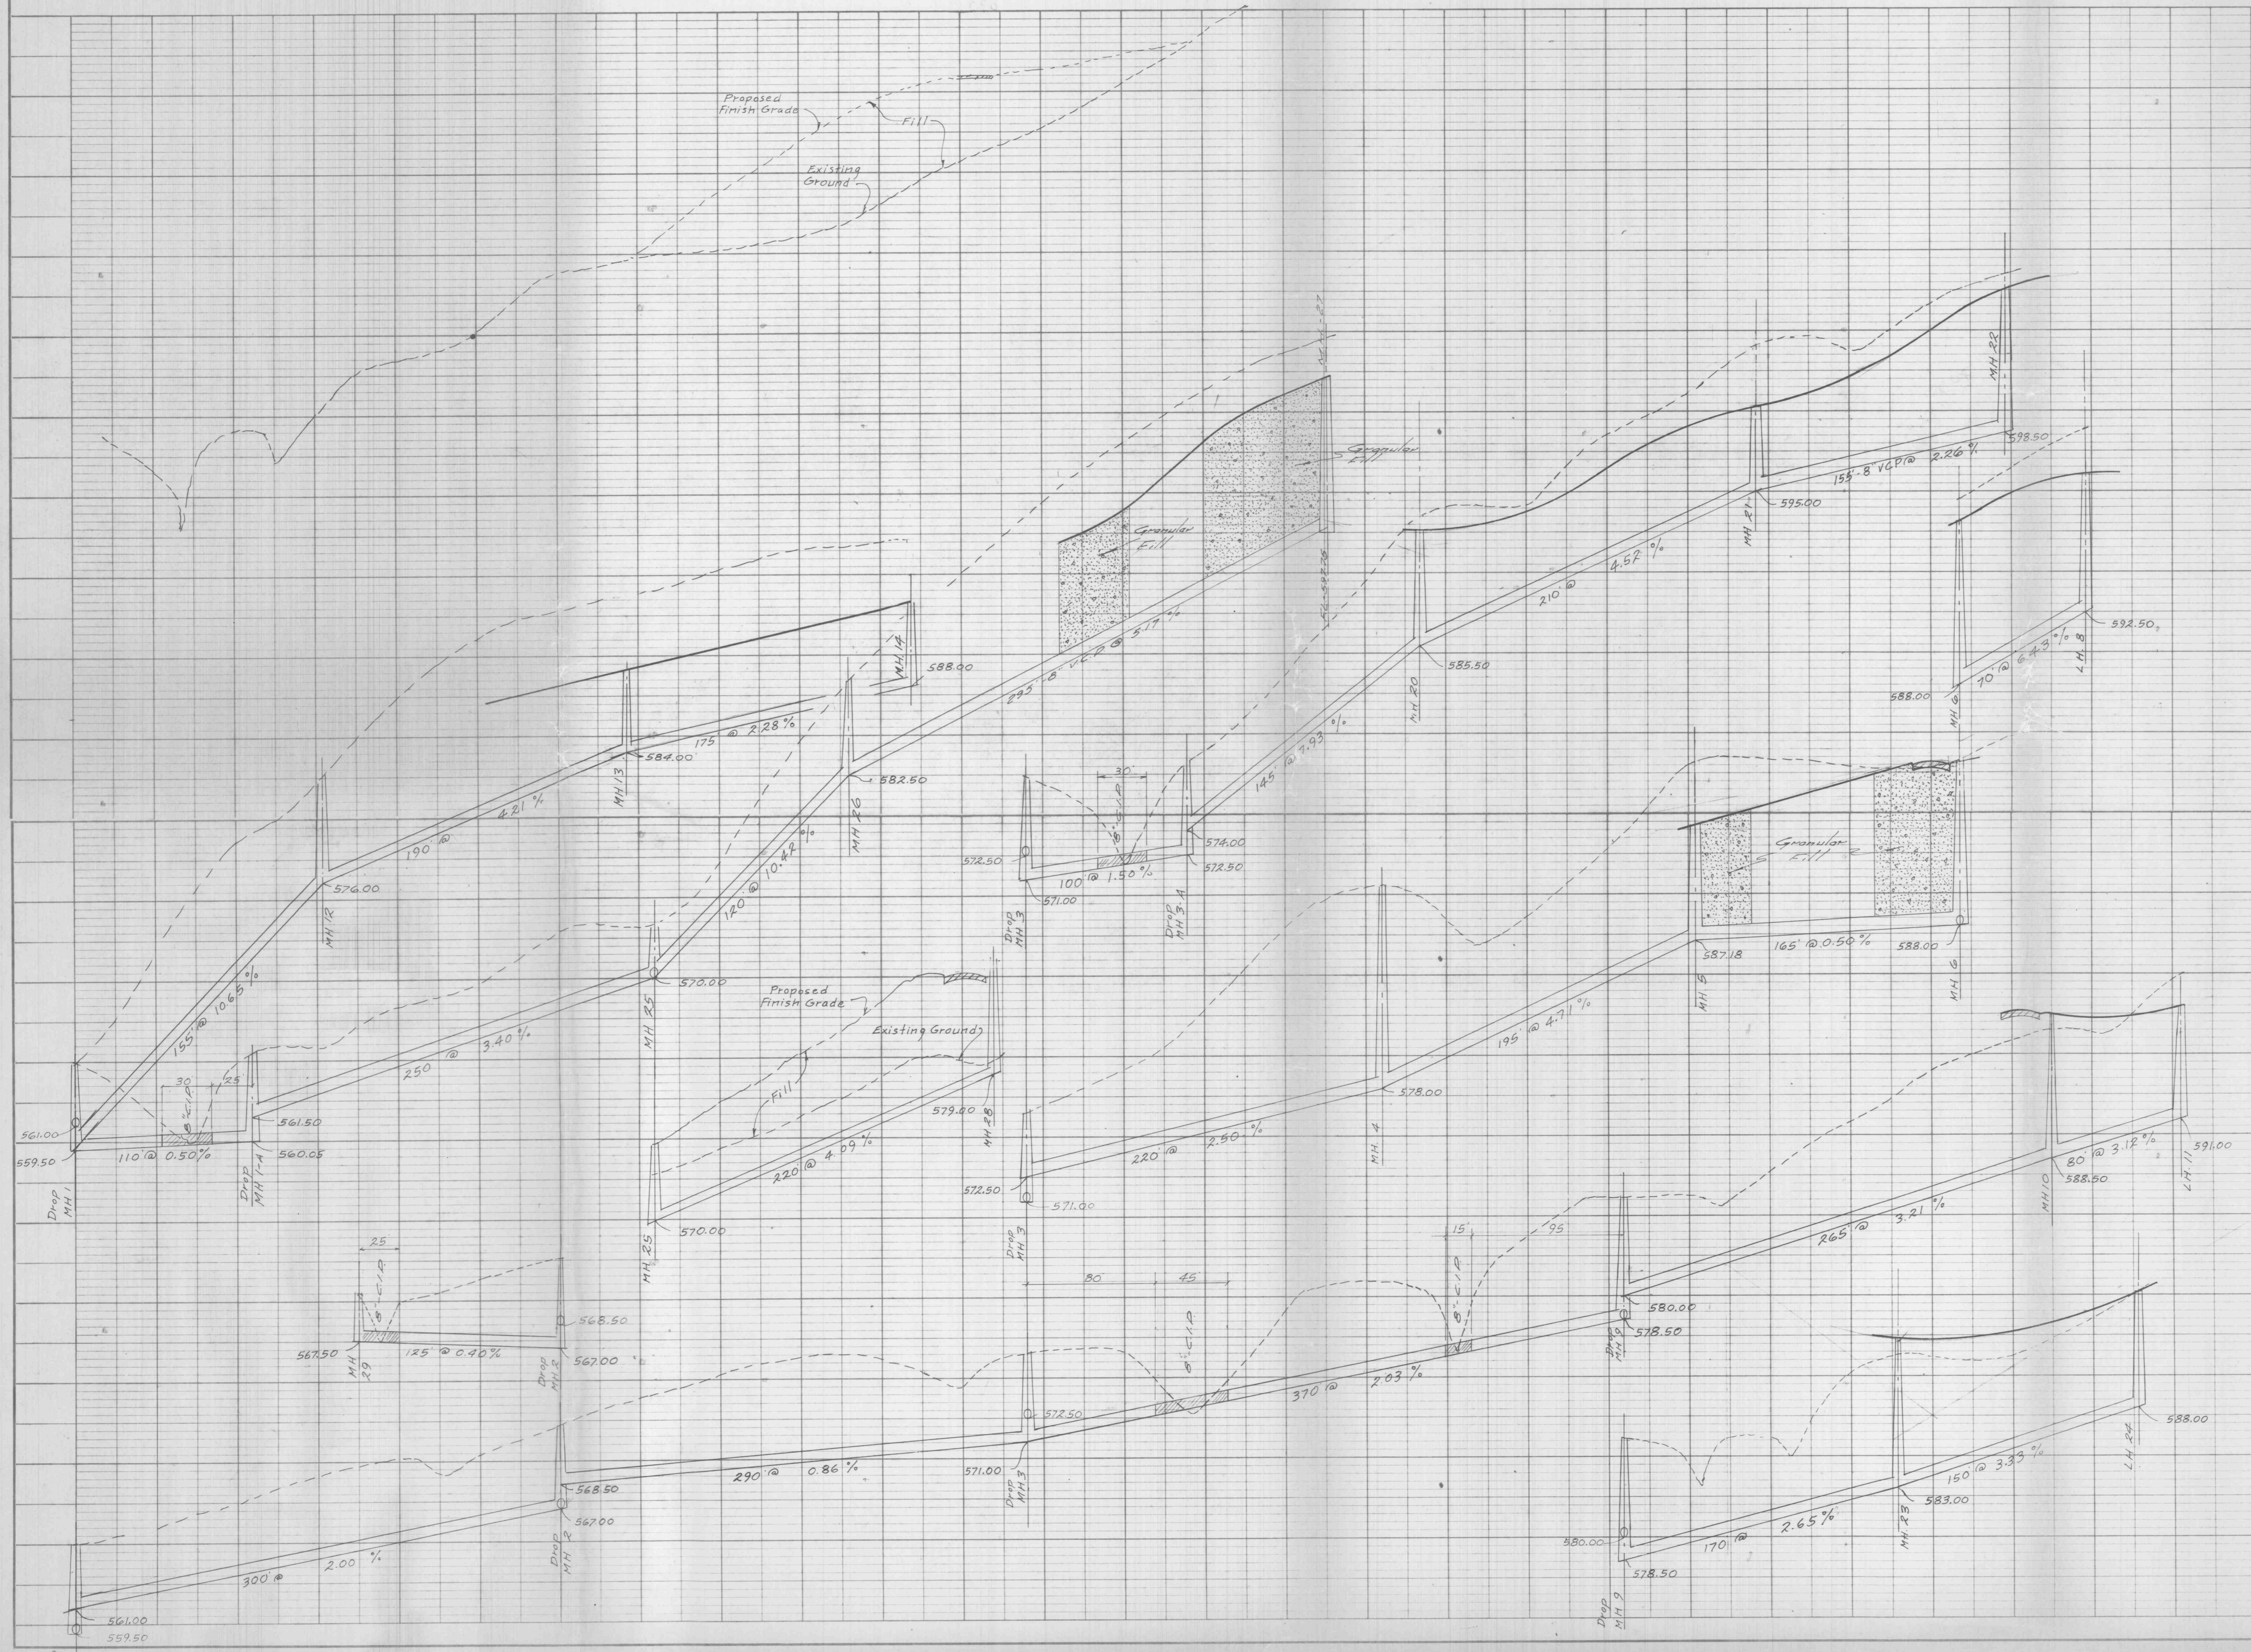

- NOTE:**
1. There shall be granular fill under all paved streets.
  2. All sanitary sewer lines are to be 8" V.C.P. except where noted.
  3. Build tops of manholes to finish grade.
  4. C.I.P. at ditch crossings to have 6" by 2" conc. collar at joints. A full length of cast iron sewer pipe shall be centered at ditch crossings.

WESTBROOK MANOR  
O FALLON, MO.

Sheet 5 of 9