







8' HIGH VINYL PRIVACY FENCE
NOT TO SCALE

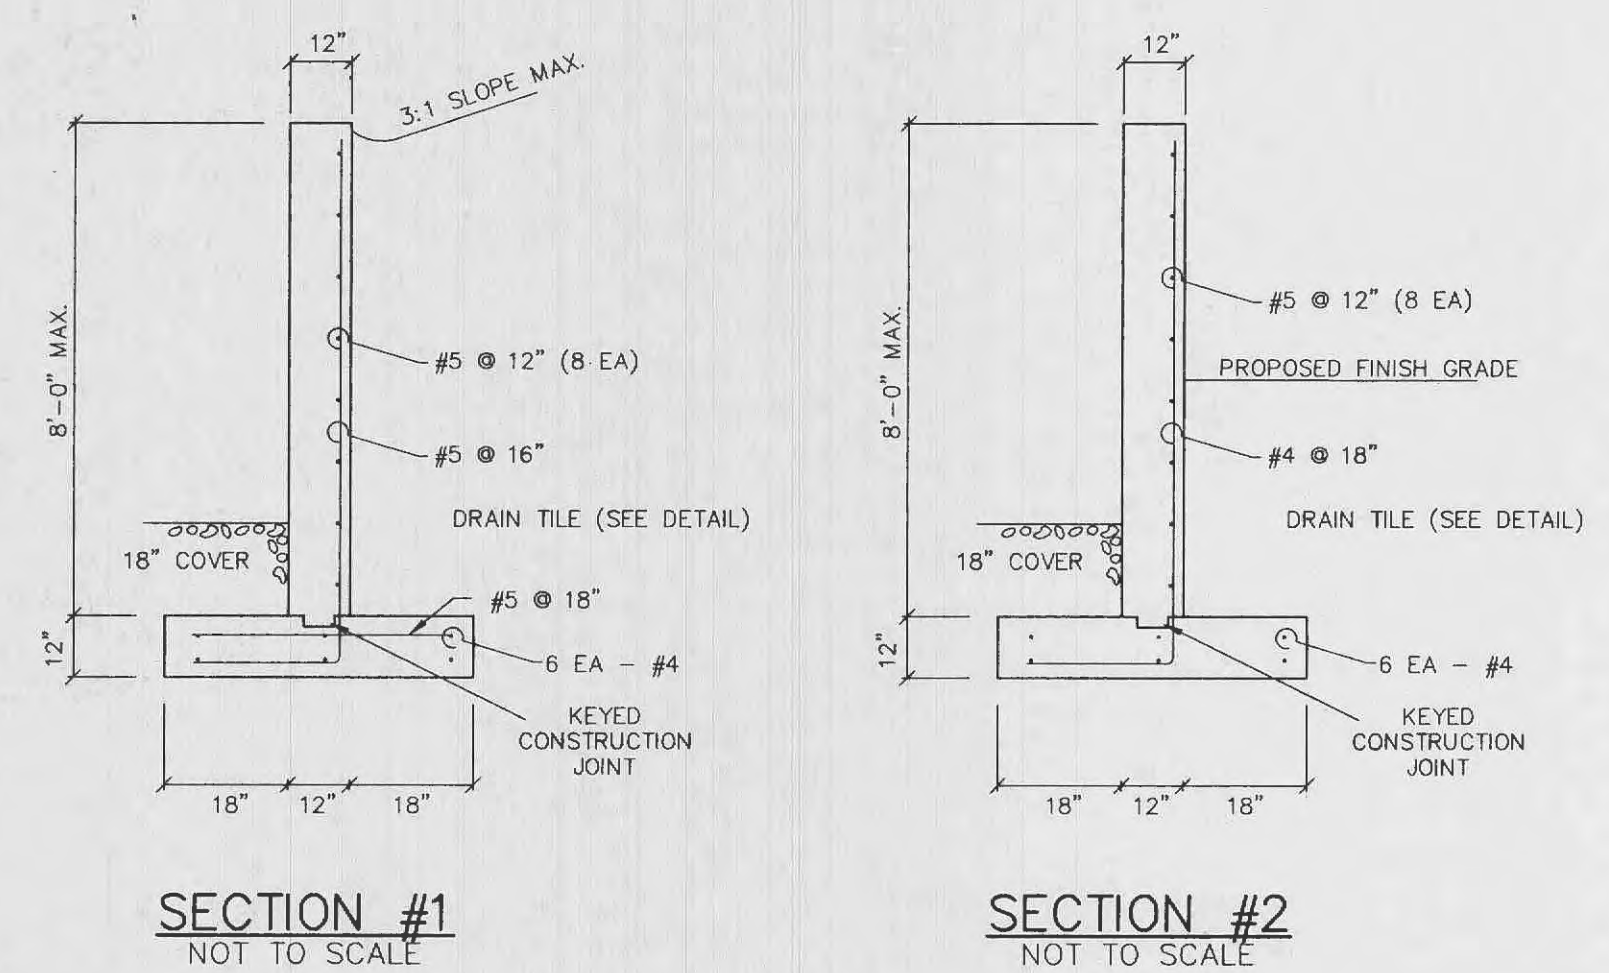

- GENERAL DETAIL NOTES**
- Concrete $f_c = 3000$ p.s.i.
 - Reinforced steel: Grade 60 (min.) $f_y = 60,000$ p.s.i. $f_s = 24,000$ p.s.i. (min.)
 - Soil beneath footing to have allowable soil pressure of 2,000 p.s.i. minimum.
 - Clear distance for reinforcement: Bottom reinforcement of footings = 3" or other locations = 2"
 - Construction joints to be at 35' minimum on center.
 - Backfill to be compacted to 90% of maximum density as determined by the "Modified AASHTO T-180 Compaction Test."
 - Bottom of footings of reinforced concrete retaining wall shall be minimum of 30" below ground surface.
 - Underground utilities have been plotted from available information and therefore their locations shall be considered approximate only. The verification of the location of all underground utilities, either shown or not shown on these plans shall be the responsibility of the contractor, and shall be located prior to any grading or construction of the improvements.
 - When stem wall and foundation are poured separately, a 2"x6" keyed construction joint shall be provided between stem wall and foundation.
 - Rails or Fencing shall be constructed along the top of all walls.

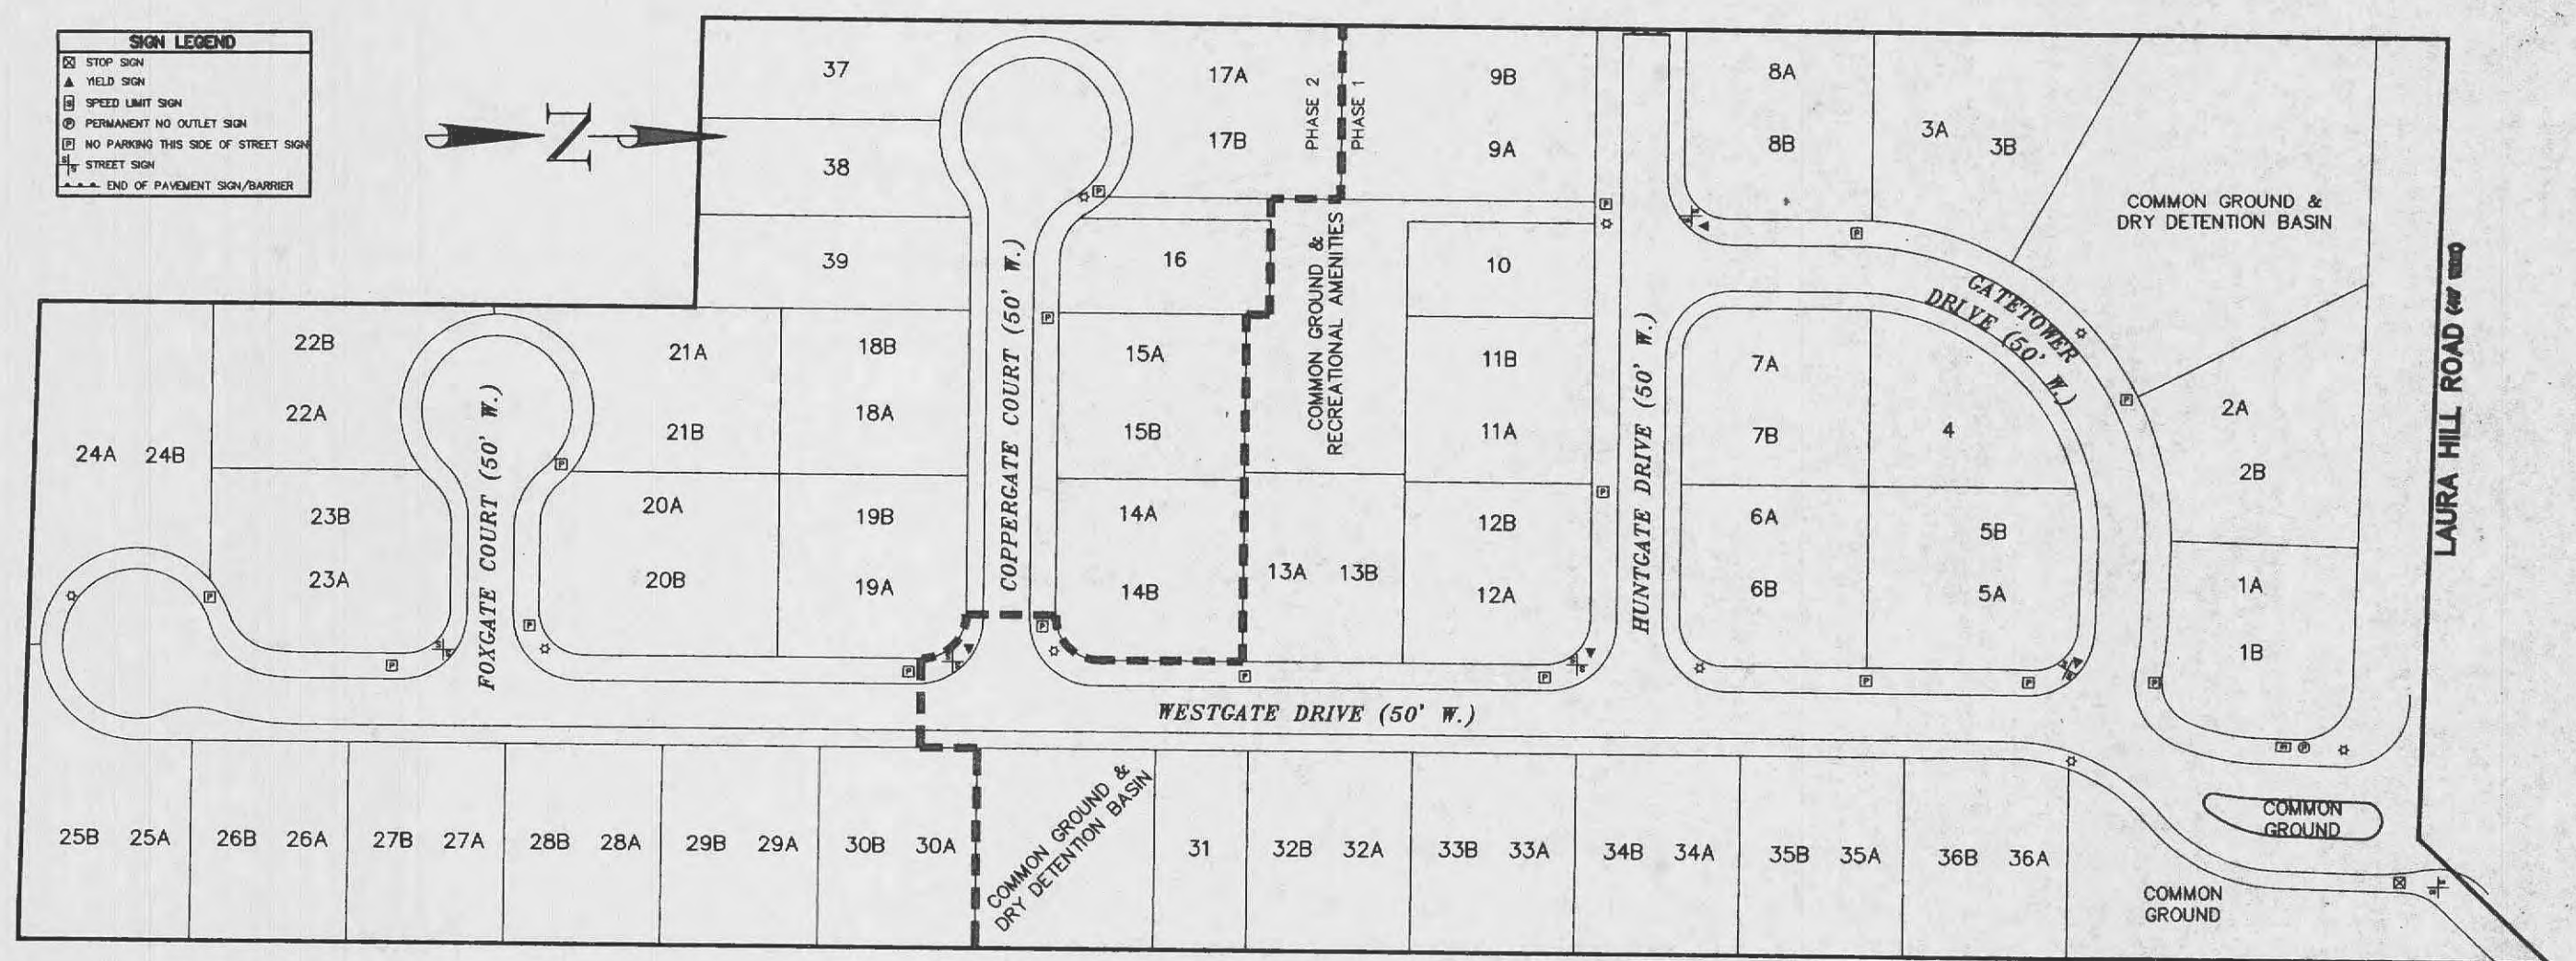

LIGHTING & SIGN DETAIL
NOT TO SCALE

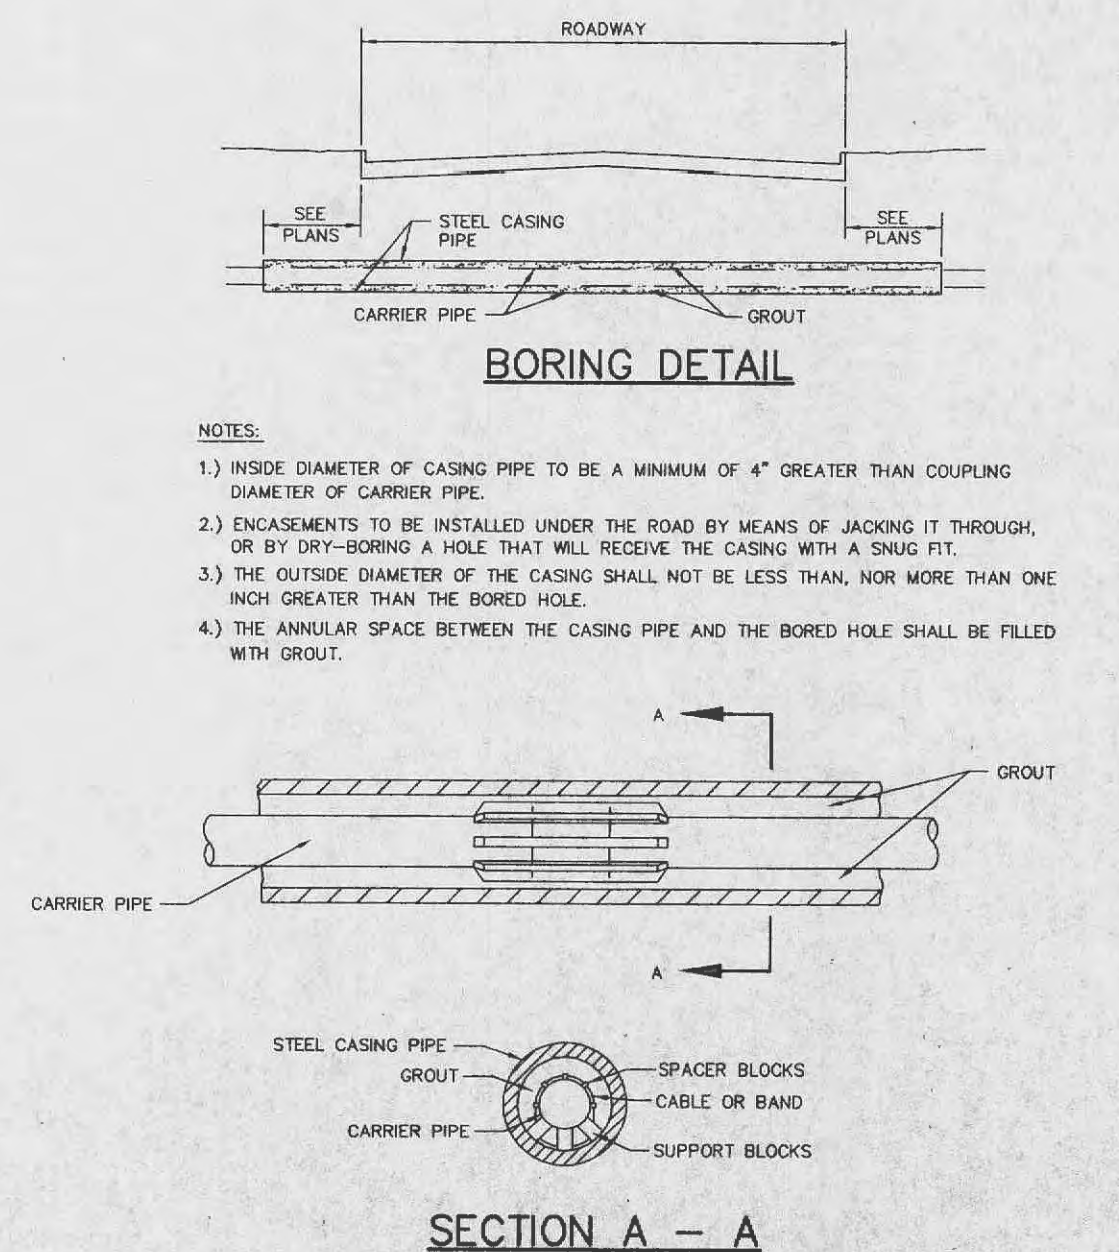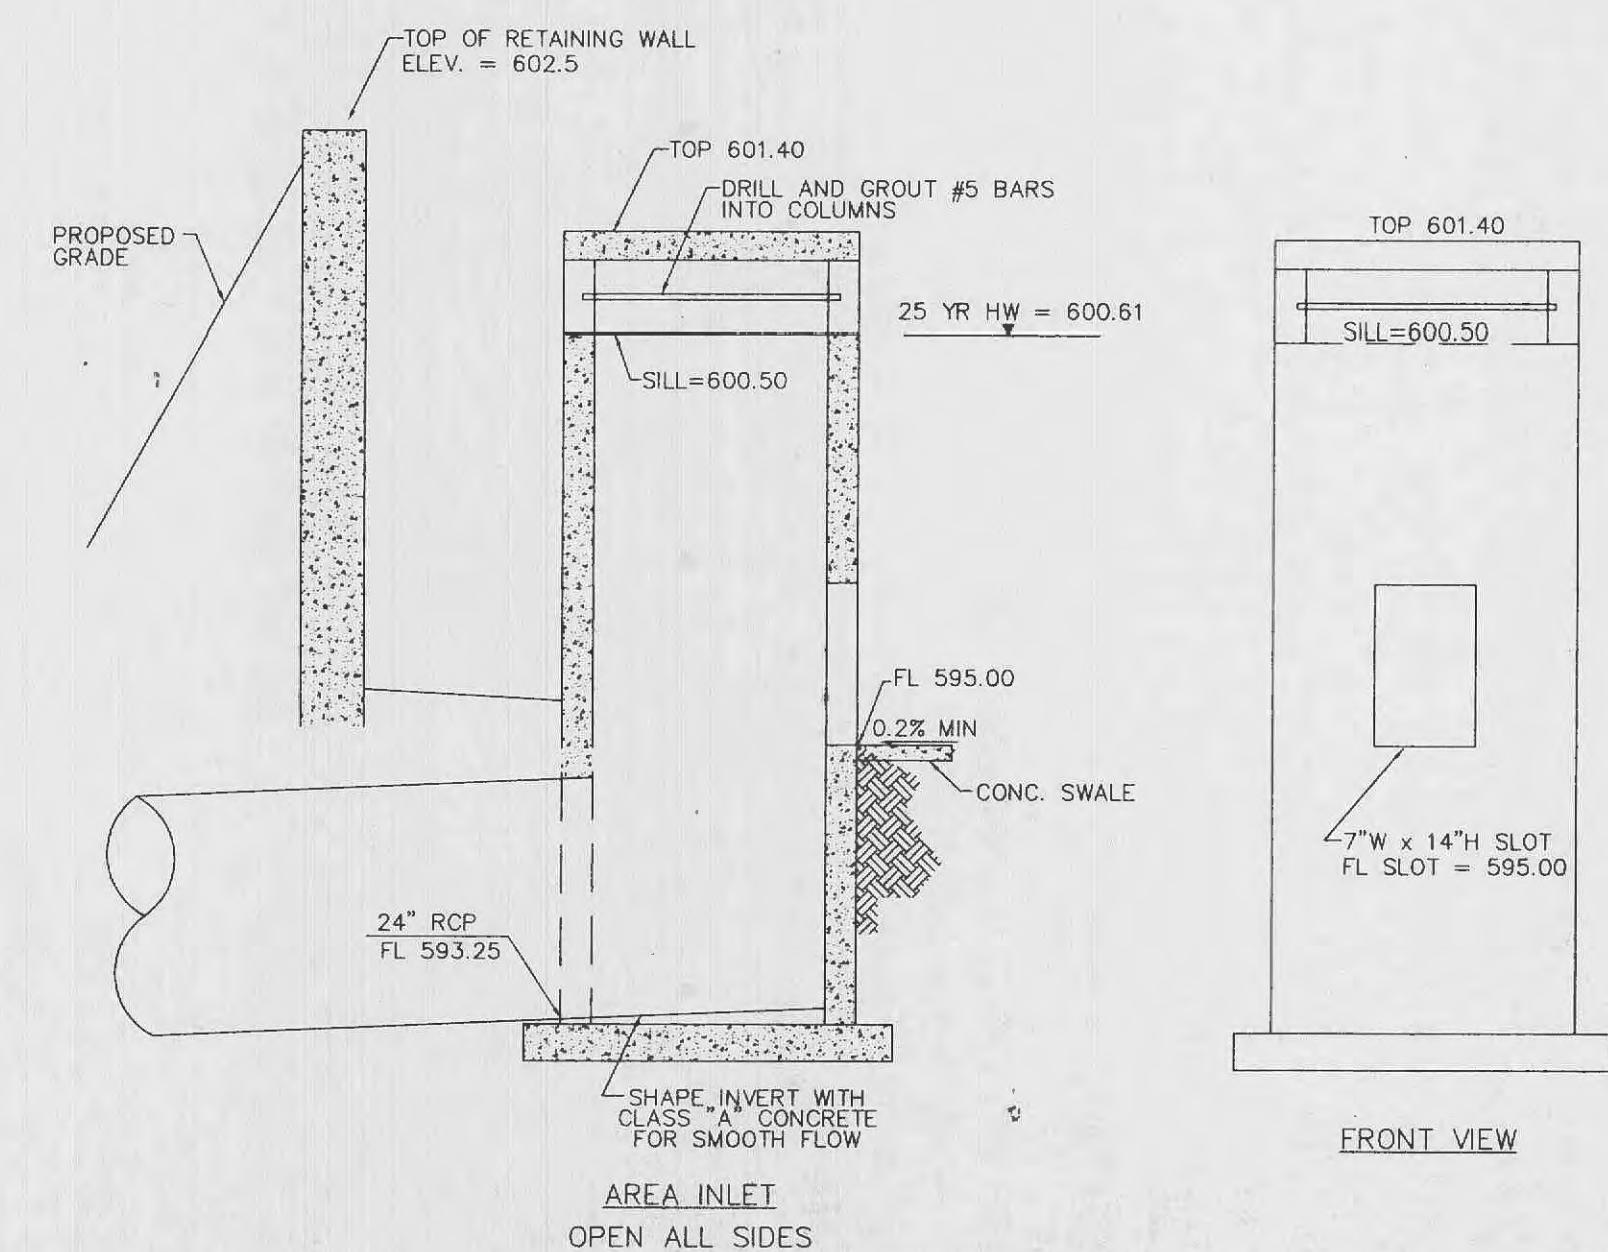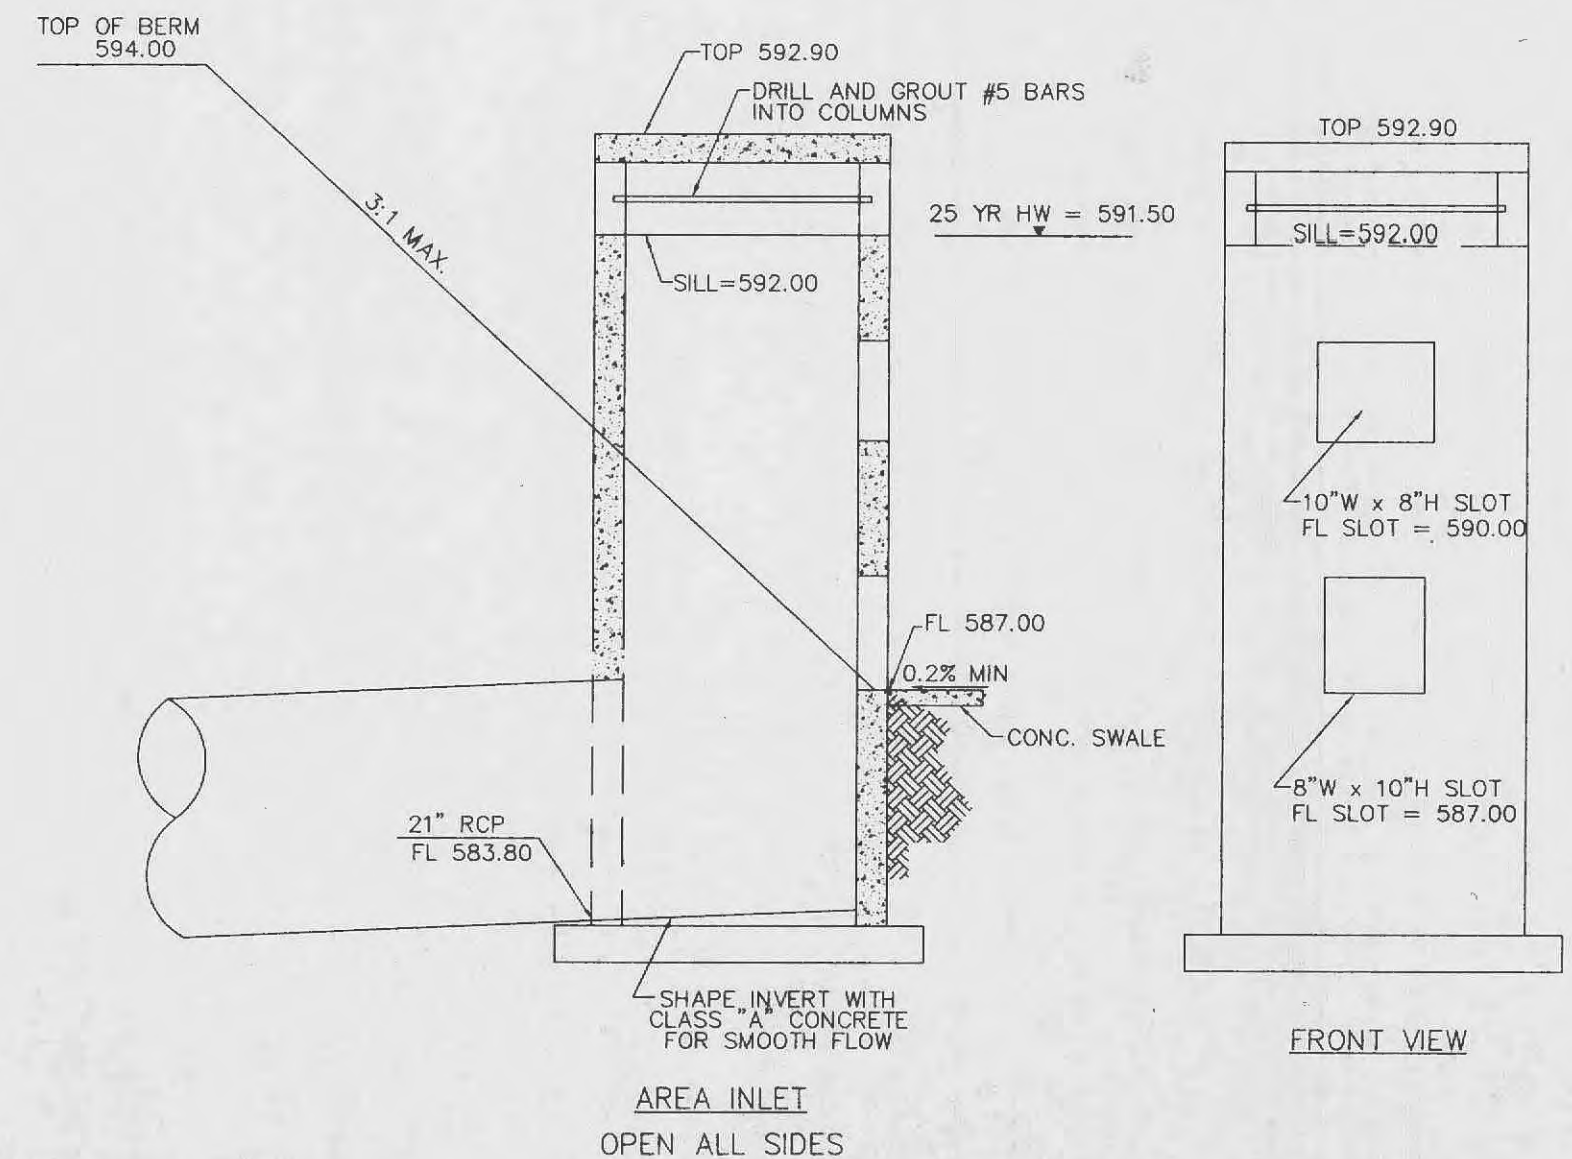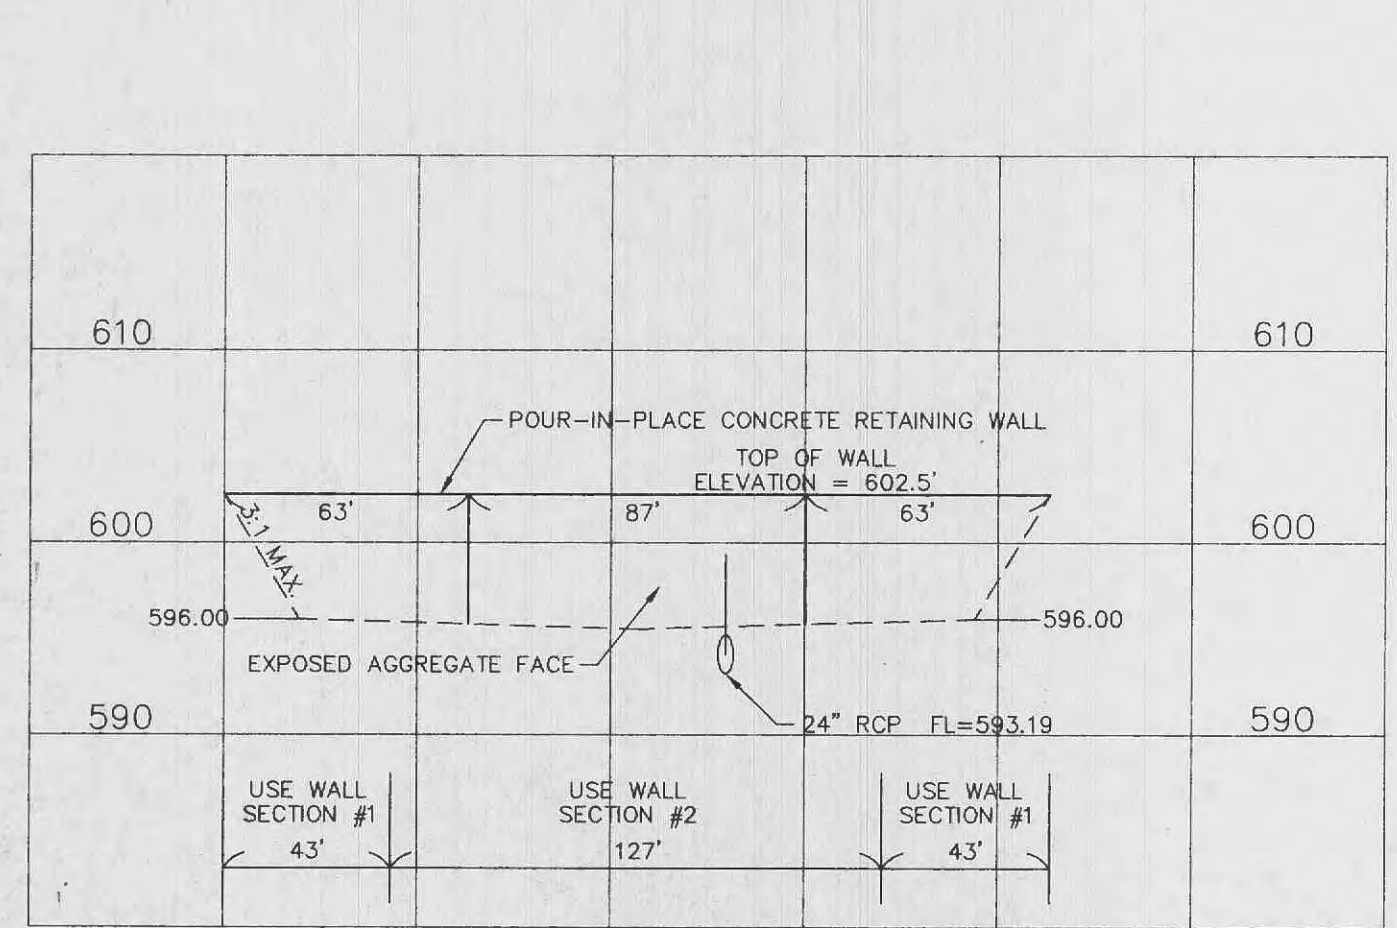

- NOTES:**
- INSIDE DIAMETER OF CASING PIPE TO BE A MINIMUM OF 4" GREATER THAN COUPLING DIAMETER OF CARRIER PIPE.
 - ENCASUREMENTS TO BE INSTALLED UNDER THE ROAD BY MEANS OF JACKING IT THROUGH, OR BY DRILL-BORING A HOLE THAT WILL RECEIVE THE CASING WITH A SNAUG FIT.
 - THE OUTSIDE DIAMETER OF THE CASING SHALL NOT BE LESS THAN, NOR MORE THAN ONE INCH GREATER THAN THE BORED HOLE.
 - THE ANNULAR SPACE BETWEEN THE CASING PIPE AND THE BORED HOLE SHALL BE FILLED WITH GROUT.

E:\WORK\1000000\10343cov.dwg Tue Sep 26 14:23:41 2000 STATION 16 RLA