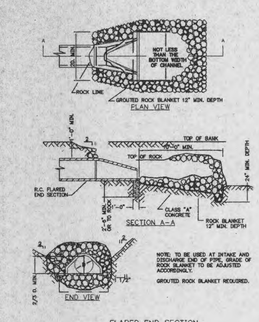

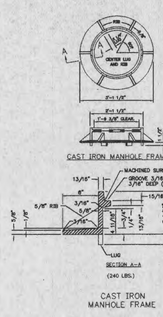

CAST IRON MANHOLE FRAME

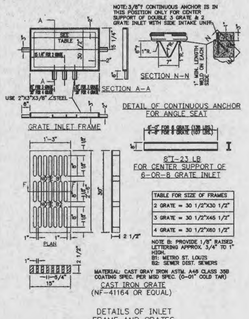

DETAILS OF INLET FRAME AND GRATES

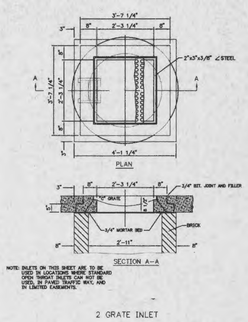

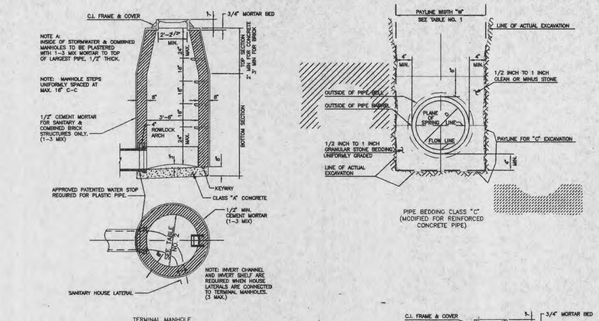



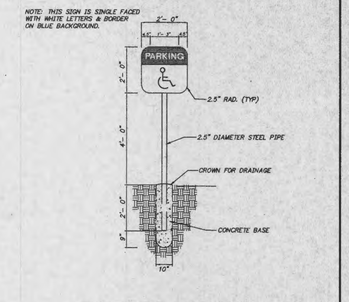



Siltation Control

Siltation control shall consist of temporary berms and swales to divert storm water run-off to a natural discharge point. (See Grading Plan for locations.) At which point there shall be a double row of straw bales with four feet of separation between bales and straw bales shall be staggered. In areas where a berm and swales are not feasible, a single row of straw bales shall be placed end to end to protect adjacent property and right-of-ways (this shall be the responsibility of the grading contractor or developer if so agreed). Upon completion of storm sewers, straw bales shall be placed on all sides of appropriate structures to keep silt out of storm sewer (this shall be the responsibility of the sewer contractor or the developer if so agreed). all straw bales shall be securely anchored and properly maintained until all disturbed areas are paved or vegetation established.





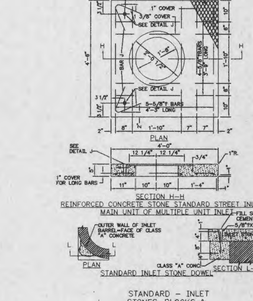

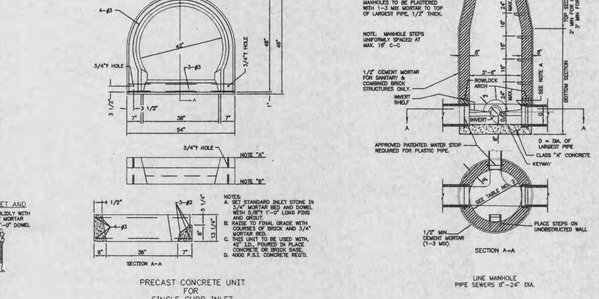



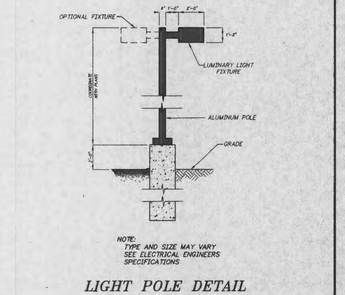









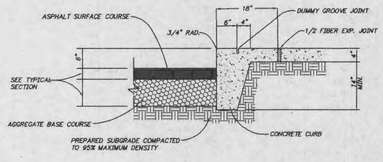

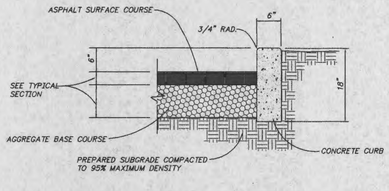





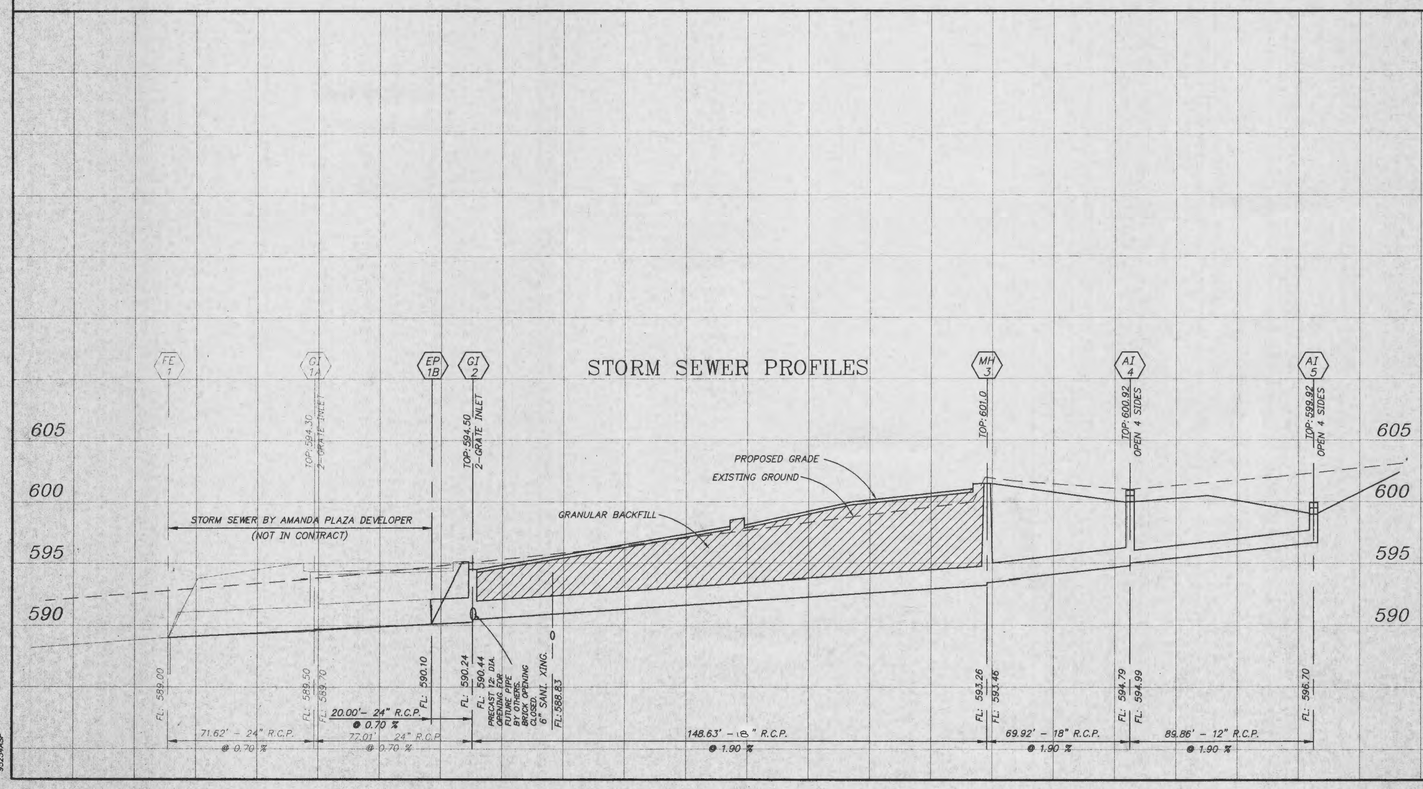

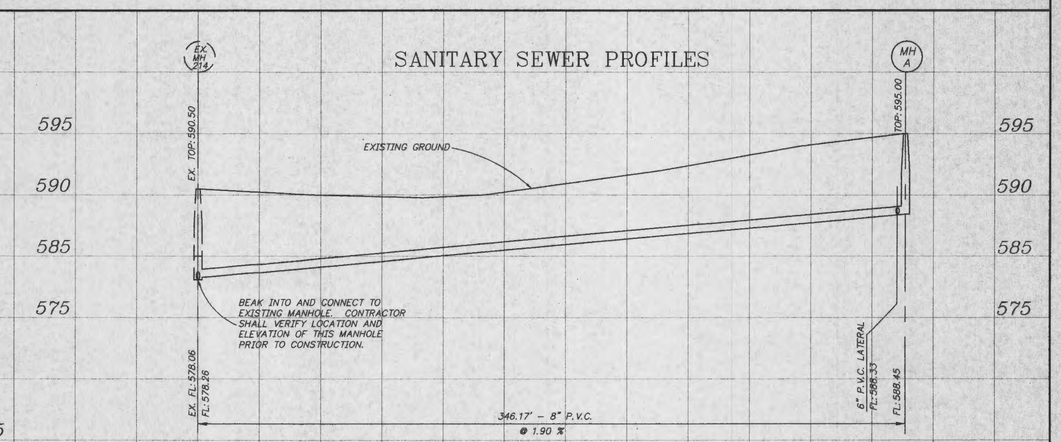

SCALE:
1" = 30' HORIZ.
1" = 5' VERT.

© Copyright 1997 by Pickett, Ray & Silver Inc.
CONFIDENTIAL PROPRIETARY MATERIAL
The use, reproduction and sales rights of this drawing are reserved by Pickett, Ray & Silver Inc.

PICKETT RAY & SILVER
Civil Engineers
Planners
Land Surveyors
333 Mid Rivers Mall Dr.
St. Peters, MO 63376
397-1211 FAX 397-1904

THE WILCOXEN BUILDING
SEWER PROFILES & DETAILS

DRAWN	GJP	DATE	3-22-97
CHECKED		DATE	
FIELD BOOK	617	PROJECT # / JOB ORDER #	95-234A / 35436

3/4

9323MJGP