

A SET OF CONSTRUCTION PLANS FOR WILLERDING WELDING COMPANY A TRACT OF LAND LOCATED IN THE SOUTHWEST QUARTER OF THE NORTHWEST QUARTER OF SECTION 30, TOWNSHIP 47 NORTH, RANGE 3 EAST OF THE FIFTH PRINCIPAL MERIDIAN, ST. CHARLES COUNTY, MISSOURI

PRINCIPALS & STANDARDS

- All excavations, grading, or filling shall have a finished grade not to exceed a 3:1 slope (33%). Steeper grades may be approved by the designated official if the excavation is through rock or the excavation or the fill is adequately protected (a designed head wall or toe wall may be required). Retaining walls that exceed a height of four (4) feet shall require the construction of safety guards as identified in the appropriate section(s) of the adopted BOCA Codes and must be approved by the City Building Department. Permanent safety guards will be constructed in accordance with the appropriate section(s) of the adopted BOCA Codes.
 - Sediment and erosion control plans for sites that exceed 20,000 square feet of grading shall provide for sediment or debris basins, silt traps or filters, staked straw bales or other approved measures to remove sediment from run-off water. Temporary siltation control measures shall be maintained until vegetative cover is established at a sufficient density to provide erosion control on the site.
 - Where natural vegetation is removed during grading, vegetation shall be re-established in such a density as to prevent erosion. Permanent type grasses shall be established as soon as possible during the next seeding period after grading has been completed.
 - When grading operations are completed or suspended for more than 30 days permanent grass must be established at sufficient density to provide erosion control on the site. Between permanent grass seeding periods, temporary cover shall be provided.
- All finished grades (areas not to be disturbed by future improvement) in excess of 20% slopes (5:1) shall be mulched and locked at the rate of 100 pounds per 1,000 square feet when seeded.
- Provisions shall be made to accommodate the increased runoff caused by changed soils and surface conditions during and after grading. Unvegetated open channels shall be designed so that gradients result in velocities of 2 fps (feet per second) or less. Open channels with velocities more than 2 fps and less than 5 fps shall be established in permanent vegetation by use of commercial erosion control blankets or lined with rock riprap or concrete or other suitable materials. Detention basins, diversions or any other appropriate structures shall be constructed to prevent velocities above 5 fps.
 - The adjoining ground to development sites (lots) shall be provided with protection from accelerated and increased surface water, silt from erosion, and any other consequence of erosion. Run-off water from developed areas (parking lots, paved sites and buildings) above the area to be developed shall be directed to diversions, detention basins, concrete gutters and/or underground outlet systems. Sufficiently anchored straw bales may be temporarily substituted.
 - Development along natural watercourses shall have residential lot lines, commercial or industrial improvements, parking areas or driveways set back a minimum of 25 feet from the top of the existing stream bank. The watercourse shall be maintained and made the responsibility of the subdivision trustees or in the case of a site plan by the property owner. Permanent vegetation should be left intact. Variations will include designed streambank erosion control measures, FEMA and U.S. Army Corps of Engineers guidelines shall be followed where applicable regarding site development areas designated as flood plains and wetlands.
 - All lots shall be seeded and mulched or sodded before an occupancy permit shall be issued except that a temporary occupancy permit may be issued by the Building Department in cases of undue hardship because of unfavorable ground conditions.
 - Erosion control shall not be limited to what is shown on these plans. Whenever means necessary shall be taken to prevent siltation and erosion from entering natural streams and adjacent roadways, properties, and ditches.


VEGETATIVE ESTABLISHMENT For Urban Development Sites

APPENDIX A

- Seeding Rates:**
Permanent:
Tall Fescue - 30 lbs./ac.
Smooth Brome - 20 lbs./ac.
Combined Fescue @ 15 lbs./ac. and Brome @ 10 lbs./ac.
- Temporary:**
Wheat or Rye - 150 lbs./ac. (3.5 lbs. per square foot)
Oats - 120 lbs./ac. (2.75 lbs. per square foot)
- Seeding Periods:**
Fescue or Brome - March 1 to June 1
August 1 to October 1
Wheat or Rye - March 15 to November 1
Oats - March 15 to September 15
- Mulch Rates:** 100 lbs. per 1,000 sq. feet (4,356 lbs. per acre)
- Fertilizer Rates:**
- | | |
|-----------|-------------------|
| Nitrogen | 30 lbs./ac. |
| Phosphate | 30 lbs./ac. |
| Potassium | 30 lbs./ac. |
| Lime | 600 lbs./ac. ENM* |
- * ENM = effective neutralizing material as per State evaluation of quarried rock.

GRADING NOTES

- A Geotechnical Engineer shall be employed by the owner and on site during grading operations. All soils tests shall be verified by the Geotechnical Engineer concurrent with the grading and backfilling operations.
 - The grading contractor shall perform a complete grading and compaction operation as shown on the plans, stated in these notes, or reasonably implied there from, all in accordance with the plans and notes as interpreted by the Geotechnical Engineer.
 - The Contractor shall notify the Soils Engineer at least two days in advance of the start of the grading operation.
 - All areas shall be allowed to drain. All low points shall be provided with temporary ditches.
 - A sediment control plan that includes monitored and maintained sediment control basins and/or straw bales should be implemented as soon as possible. No graded area is to be allowed to remain bare without being seeded and mulched. Care should be exercised to prevent soil from damaging adjacent property and silt up existing downstream storm drainage system.
 - Debris and foundation material from any existing on-site building or structure which is scheduled to be razed for this development must be disposed of off-site.
 - All trash and debris on site, either existing or from construction, must be removed and properly disposed of off-site.
 - Soft soil in the bottom and banks of any existing or former pond sites or tributaries or on any sediment basins or traps should be removed, spread out and permitted to dry sufficiently to be used as fill. None of this material should be placed in proposed public right-of-way locations or on any storm sewer locations.
 - Site preparation includes the clearance of all stumps, trees, bushes, shrubs, and weeds; the grubbing and removal of roots and other surface obstructions from the site; and the demolition and removal of any man-made structures. The material shall be properly disposed of off-site. Topsoil and grass in the fill areas shall be thoroughly discing prior to the placement of any fill. The Soils Engineer shall approve the discing operation.
 - Compaction equipment shall consist of tamping rollers, pneumatic-tired rollers, vibratory roller, or high speed impact type drum rollers acceptable to the Soils Engineer. The roller shall be designed so as to avoid the creation of a layered fill without proper blending of successive fill layers.
 - The Soils Engineer shall observe and test the placement of the fill to verify that specifications are met. A series of fill density tests will be determined on each lift of fill. Interim reports showing fill quality will be made to the Owner at regular intervals.
 - The Soils Engineer shall notify the Contractor of rejection of a lift of fill or portion thereof. The Contractor shall rework the rejected portion of fill and obtain notification from the Soils Engineer of its acceptance prior to the placement of additional fill.
 - All areas to receive fill shall be scarified to a depth of not less than 6 inches and then compacted in accordance with the specifications given below. Natural slopes steeper than 1 vertical to 5 horizontal to receive fill shall have horizontal benches, cut into the slopes before the placement of any fill. The width and height to be determined by the Soils Engineer. The fill shall be loosely placed in horizontal layers not exceeding 8 inches in thickness and compacted in accordance with the specifications given below. The Soils Engineer shall be responsible for determining the acceptability of soils placed. Any unacceptable soils placed shall be removed at the Contractor's expense.
 - The sequence of operation in the fill areas will be fill, compact, verify acceptable soil density, and repetition of the sequence. The acceptable moisture contents during the filling operation are those at which satisfactory dry densities can be obtained. The acceptable moisture contents during the filling operation in the remaining areas are from 2 to 8 percent above the optimum moisture control.
 - The surface of the fill shall be finished so that it will not impound water. If at the end of a days work it would appear that there may be rain prior to the next working day, the surface shall be finished smooth. If the surface has been finished smooth for any reason, it shall be scarified before proceeding with the placement of succeeding lifts. Fill shall not be placed on frozen ground, nor shall filling operations continue when the temperature is such as to permit the layer under placement to freeze.
 - Fill and backfill should be compacted to the criteria specified in the following table:
- | CATEGORY | MINIMUM PERCENT COMPACTION |
|---------------------------------------|----------------------------|
| Fill in building areas below footings | 90% |
| Fill under slabs, walks, and pavement | 90% |
| Fill other than building areas | 90% |
| Natural subgrade | 90% |
| Pavement subgrade | 90% |
| Pavement base course | 92% |
- Measured as a percent of the maximum dry density as determined by modified Proctor Test (ASTM-D-1557).
- Moisture content must be within 2 percent below or 4 percent above optimum moisture content if fill is deeper than 10 feet.

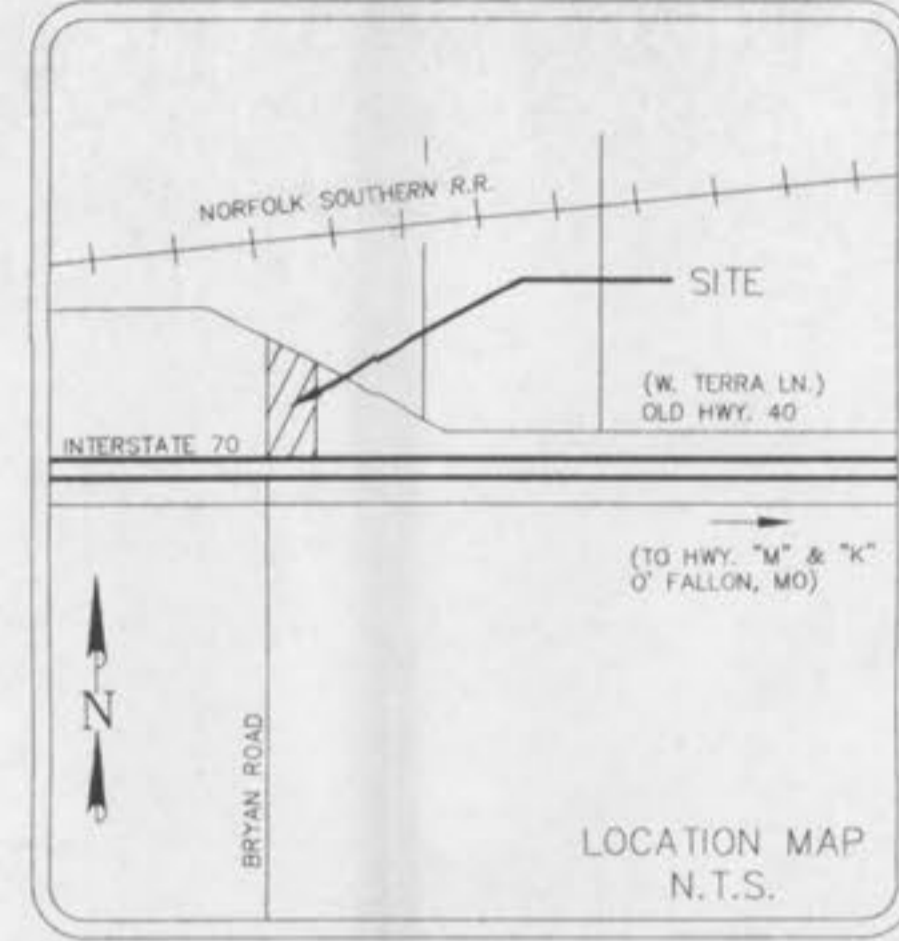

SHEET INDEX

COVER SHEET	1 OF 6
SITE PLAN	2 OF 6
GRADING PLAN	3 OF 6
DRAINAGE AREA MAP	4 OF 6
DETAILS SHEET	5-6 OF 6

LEGEND

- - UTILITY POLE
- - IRON PIPE
- - SANITARY MANHOLE
- SAN- - SANITARY SEWER
- STM- - STORM SEWER
- OHW- - OVERHEAD UTILITY WIRES
- CMP- - CORRUGATED METAL PIPE
- RCP- - REINFORCED CONCRETE PIPE
- UGE- - BURIED ELECTRIC
- - BOLLARDS
- ⊗ - GAS METER
- ⊕ - SIGN
- W - - WATER LINE
- G - - GAS LINE
- - GUY WIRE

GRADING QUANTITIES:
9,356 C.Y. CUT
1,948 C.Y. FILL (INCLUDES 15% SHRINKAGE)
7,408 C.Y. EXCESS

THE ABOVE GRADING QUANTITY IS APPROXIMATE, NOT FOR BIDDING PURPOSES. CONTRACTOR SHALL VERIFY QUANTITIES PRIOR TO CONSTRUCTION.

SITE BENCHMARK

ELEVATION 570.56 FEET (U.S.G.S.)
"O" IN OPEN ON TOP OF FIRE HYDRANT, LOCATED ALONG WEST TERRA LANE AT THE NORTHWEST CORNER OF WILLERDING WELDING COMPANY, INC. SITE. (AS SHOWN ON SURVEY). BENCHMARK USED FOR SURVEY PERFORMED BY BAX ENGINEERING COMPANY, INC. FOR WEBER QUARRY SITE.

GENERAL NOTES

- UNDERGROUND UTILITIES HAVE BEEN PLOTTED FROM AVAILABLE INFORMATION AND THEREFORE THEIR LOCATIONS SHALL BE CONSIDERED APPROXIMATE ONLY. THE VERIFICATION OF THE LOCATION OF ALL UNDERGROUND UTILITIES, EITHER SHOWN OR NOT SHOWN ON THESE PLANS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR, AND SHALL BE LOCATED PRIOR TO ANY GRADING OR CONSTRUCTION OF THE IMPROVEMENTS.
- ALL FILLED PLACES, INCLUDING TRENCH BACKFILLS, UNDER BUILDINGS, PROPOSED STORM AND SANITARY SEWER LINES AND/OR PAVED AREAS, SHALL BE COMPACTED TO 90% AS DETERMINED BY THE "MODIFIED AASHTO T-180 COMPACTION TEST," (A.S.T.M.-D-1557). ALL FILLED PLACES WITHIN PUBLIC ROADWAYS SHALL BE COMPACTED TO 95% OF MAXIMUM DENSITY AS DETERMINED BY THE "STANDARD PROCTOR TEST AASHTO T-99, METHOD C" (A.S.T.M. D-698).
- ALL TRENCH BACKFILLS SHALL BE COMPACTED TO 80% OF THE MAXIMUM DENSITY AS DETERMINED BY THE "MODIFIED AASHTO T-180 COMPACTION TEST," (ASTM-D-1557). ALL TRENCH BACKFILLS UNDER PAVED AREAS INCLUDING SIDEWALKS SHALL BE GRANULAR FILL. ALL OTHER TRENCH BACKFILLS MAY BE EARTH MATERIAL (FREE OF LARGE CLODS OR STONES).
- NO AREA SHALL BE CLEARED WITHOUT THE PERMISSION OF THE PROJECT ENGINEER.
- ALL GRADES SHALL BE WITHIN 0.2 FEET OF THOSE SHOWN ON THE GRADING PLAN.
- NO SLOPE SHALL BE STEEPER THAN 3:1. ALL SLOPES SHALL BE SODDED OR SEEDED AND MULCHED.
- ALL CONSTRUCTION AND MATERIALS USED SHALL CONFORM TO CURRENT ST. CHARLES COUNTY STANDARDS.
- ALL MECHANICAL EQUIPMENT TO BE SCREENED FROM PUBLIC VIEW.
- PROPOSED BUILDING WILL COMPLY WITH CURRENT AMERICAN DISABILITY ACT REQUIREMENTS.
- SEE ARCHITECTURAL DRAWING FOR ALL BUILDING DIMENSIONS, SERVICE CONNECTIONS, DETAILS, ETC.
- ALL UTILITIES SHOWN ARE EXISTING UNLESS OTHERWISE NOTED.
- ALL DIMENSIONS ARE TO BACK OF CURB UNLESS OTHERWISE NOTED.
- ALL CONSTRUCTION METHODS AND PRACTICES TO CONFORM WITH OSHA STANDARDS.
- MINIMUM TREE REQUIREMENTS PER ZONING ORDINANCE:
STREET TREES: 497.22 L.F. FRONTAGE
1 TREE / 40 L.F. = 13 TREES
ADDITIONAL TREES: 68,840.76 S.F. OPEN SPACE
1 TREE / 4000 S.F. = 17 TREES
TOTAL TREES REQUIRED: 30 TREES
TOTAL TREES EXISTING: 7 TREES
TOTAL TREES PROPOSED: 23 TREES
- APPROXIMATELY 1.28 ACRES HAVE BEEN CLEARED, TREES SHALL BE REPLACED AS NECESSARY.
- ALL OUTSIDE TRASH CONTAINERS, HVAC UNITS, ELECTRIC, TELEPHONE, AND GAS METERS, SATELLITE DISHES, ROOFTOP MECHANICAL APPARATUS, AND OUTDOOR STORAGE AREAS SHALL BE THOROUGHLY SCREENED WITH MATERIALS AND/OR LANDSCAPING TO CONCEAL THE VISIBILITY OF SUCH ITEMS FROM THE VIEW OF RIGHTS-OF-WAY AND/OR ADJACENT PROPERTIES AS REVIEWED AND APPROVED BY THE PLANNING DIVISIONS.
- THE DEVELOPER SHALL COMPLY WITH CURRENT TREE PRESERVATION ORDINANCE NUMBER 1689 AND PROVIDE LANDSCAPING AS SET FORTH IN ARTICLE 23 OF THE CITY OF O'FALLON ZONING ORDINANCES.
- THE DEVELOPER SHALL COMPLY WITH ARTICLE 26 PERFORMANCE STANDARDS.
- THE DEVELOPER SHALL CONFORM WITH THE CURRENT COMPREHENSIVE PLAN FOR THE CITY OF O'FALLON.
- THIRY (30) PERCENT OF THE NORTH, EAST AND WEST SIDES OF THE EXISTING 5,000 S.F. BUILDING SHALL BE UPGRADED BY OVERLAYING PORTIONS OF THE METAL WITH BRICK OR STONE MATERIAL.
- TRASH ENCLOSURE ON EX. SITE WILL SERVICE NEW BUILDING ADDITION ALSO.
- ALL UTILITIES WILL BE LOCATED UNDER GROUND.
- ALL STORM SEWERS SHALL BE PRIVATELY MAINTAINED.

DEVELOPMENT NOTES

- Area of Tract: 5.83 Acres
- Existing Zoning: I-1
- Proposed Use: Warehouse
- Area of Building: 38,500 Sq.Ft.
- The required height and building setbacks are as follows:
Minimum Front Yard: 30 feet
Minimum Side Yard: 20 feet
Minimum Rear Yard: 35 feet
Maximum Height of Building: 50 feet
- Current Owner and Developer of Property: Willerding Welding Company, Inc.
P.O. Box 9492
O'Fallon, Missouri 63366
(636) 272-2366
- Site is served by:
Private Septic System
Ameran UE
St. Charles Gas Company
City of O'Fallon Water
Continental Telephone Company
O'Fallon Fire Protection District
- No Flood Plain exists on this tract per F.I.R.M. #29183 C 0240 E, dated Aug. 2, 1996
- Topographic Information is per Topographic Survey by BAX Engineering.
- Parking Required: 1 per 400 Sq.Ft. of floor area, 1 per employee
38,500 Sq.Ft./400 = 96.25 + 20 = 116.25 ~ 117
Parking Provided: 25 SPACES As required by variance (BA-V-00-51) to section 400.475.6 of the Zoning Code.
Required: 25 X 270 X .06 = 405 S.F. landscaping required
Provided: 485.05 S.F.
- Site coverage calculations:
Building: 76,902.65 Sq.Ft.
Pavement: 89,997.47 Sq.Ft.
Green Space: 87,100.76 Sq.Ft.

RECEIVED

MAY 08 2001

CITY OF O'FALLON, MO

WILLERDING WELDING COMPANY, INC.
P.O. BOX 9492
O'FALLON, MISSOURI 63366
PHONE: (636)272-2366

PREPARED FOR:

DISCLAIMER OF RESPONSIBILITY:
I hereby certify that the documents intended to be authorized by my seal are limited to the sheet, and I neither disclaim my responsibility for all other drawings, specifications, schedules, reports or other documents or instruments relating to or intended to be used for any part or parts of the architectural or engineering project or survey.

Copyright 2000
BAX Engineering Company, Inc.
All Rights Reserved

REVISIONS	
10-4-00	CITY COMMENTS
11-9-00	GRADING PLAN
11-30-00	CITY COMMENTS
01-10-01	CONSTRUCT PLANS
02-07-01	CITY COMMENTS
03-21-01	SANITARY SEWER

**ENGINEERING
PLANNING
SURVEYING**

1052 South Cloverleaf Drive
St. Peters, MO. 63376-6445
314-928-5552
FAX 928-1718

9-15-00	DATE
88-2987A	PROJECT NUMBER
1 OF 6	SHEET OF
2987ACON.DWG	FILE NAME
CLH	TITLE
CLH	DRAWN
CLH	CHECKED