
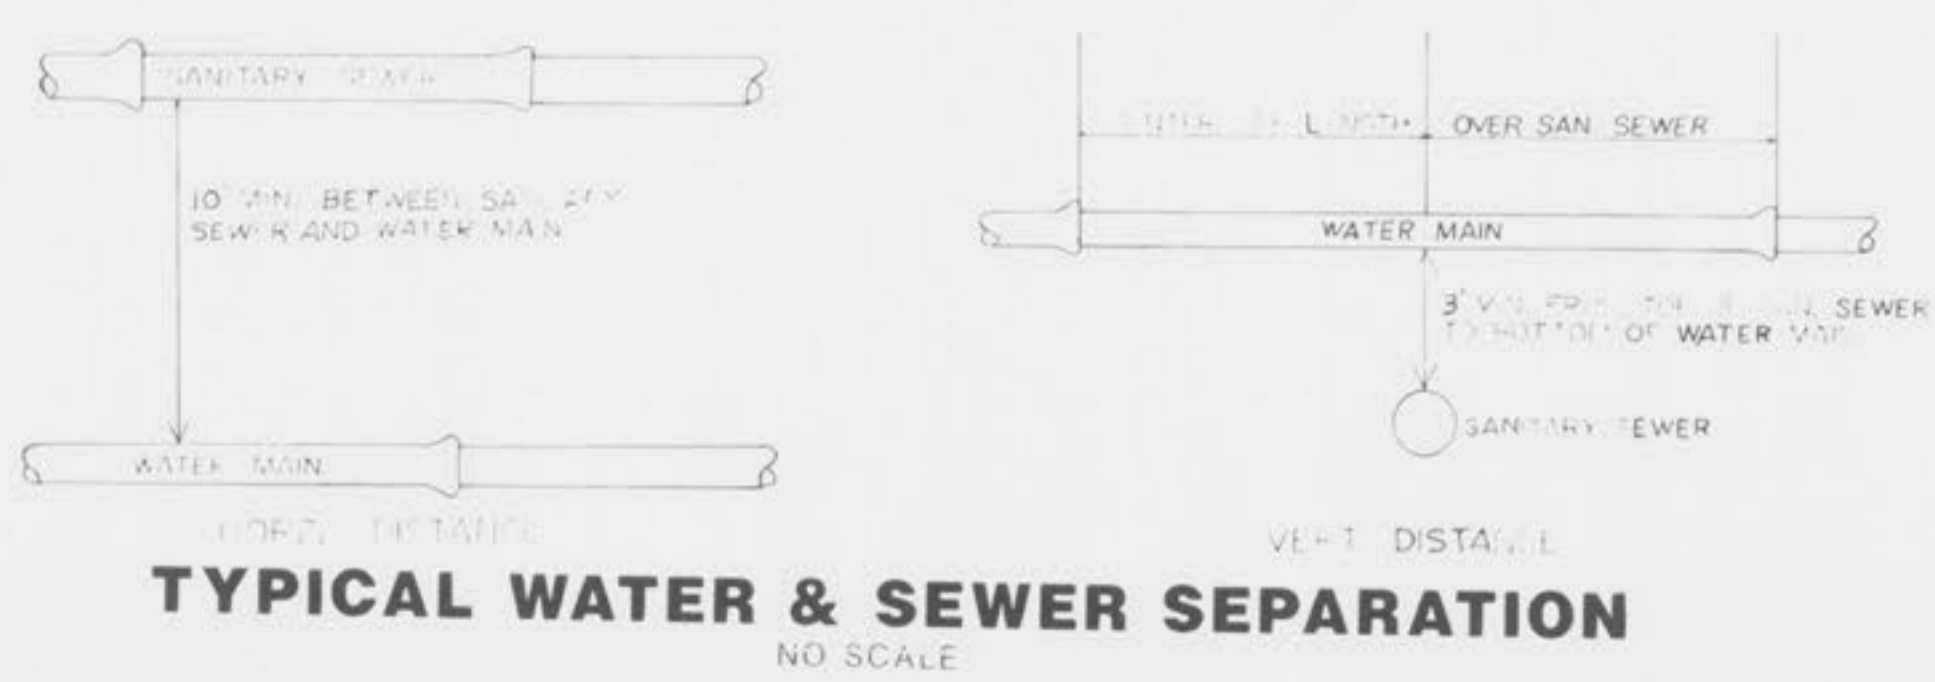
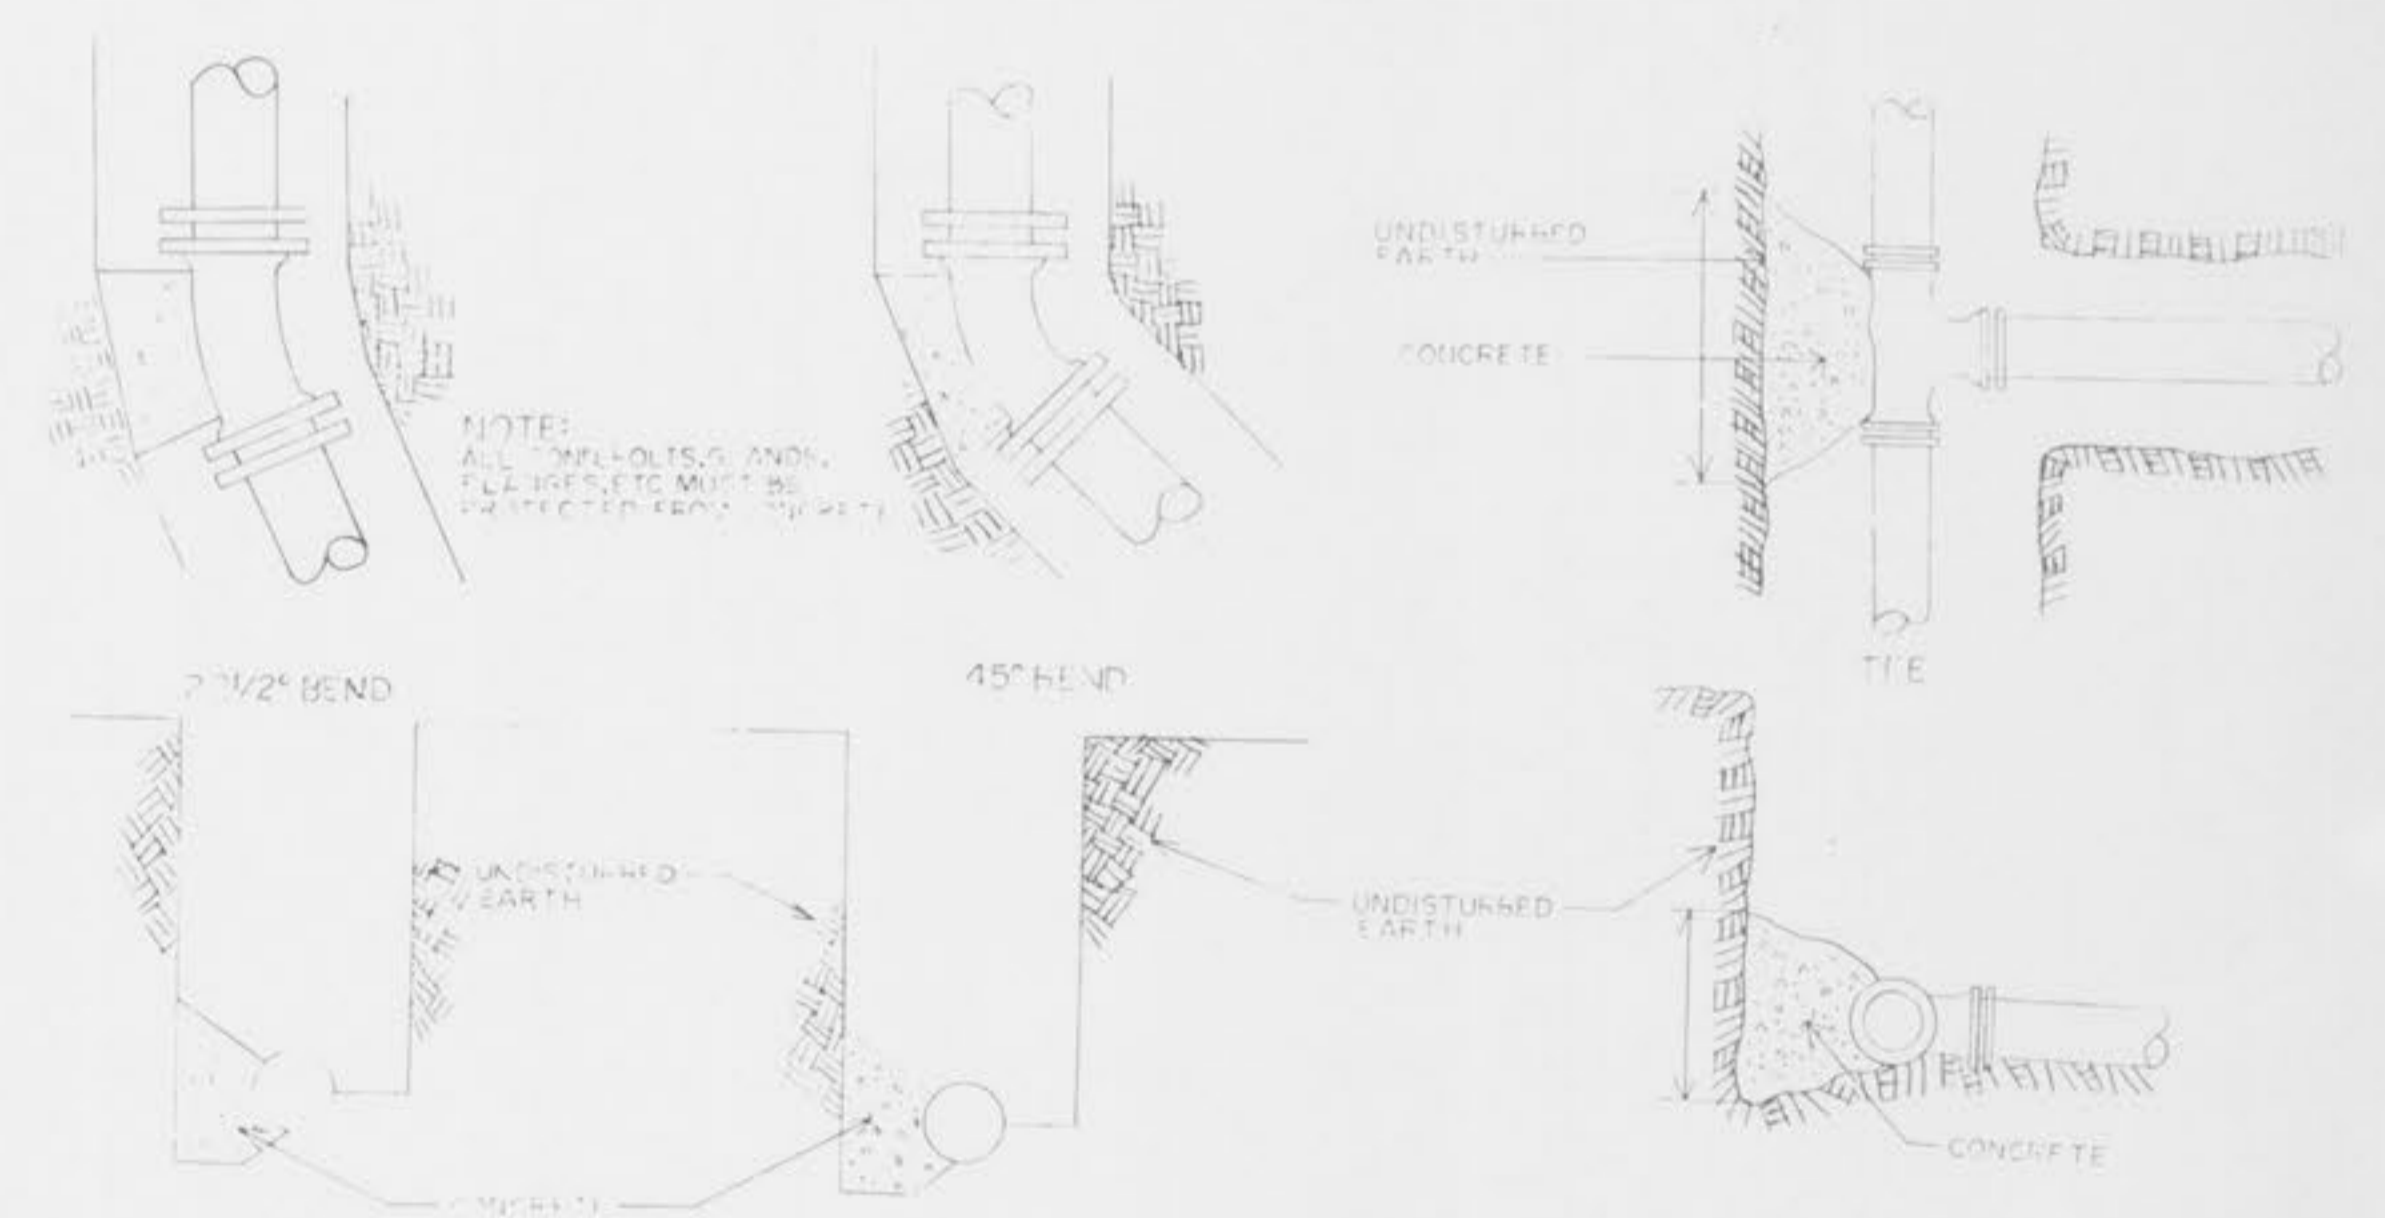
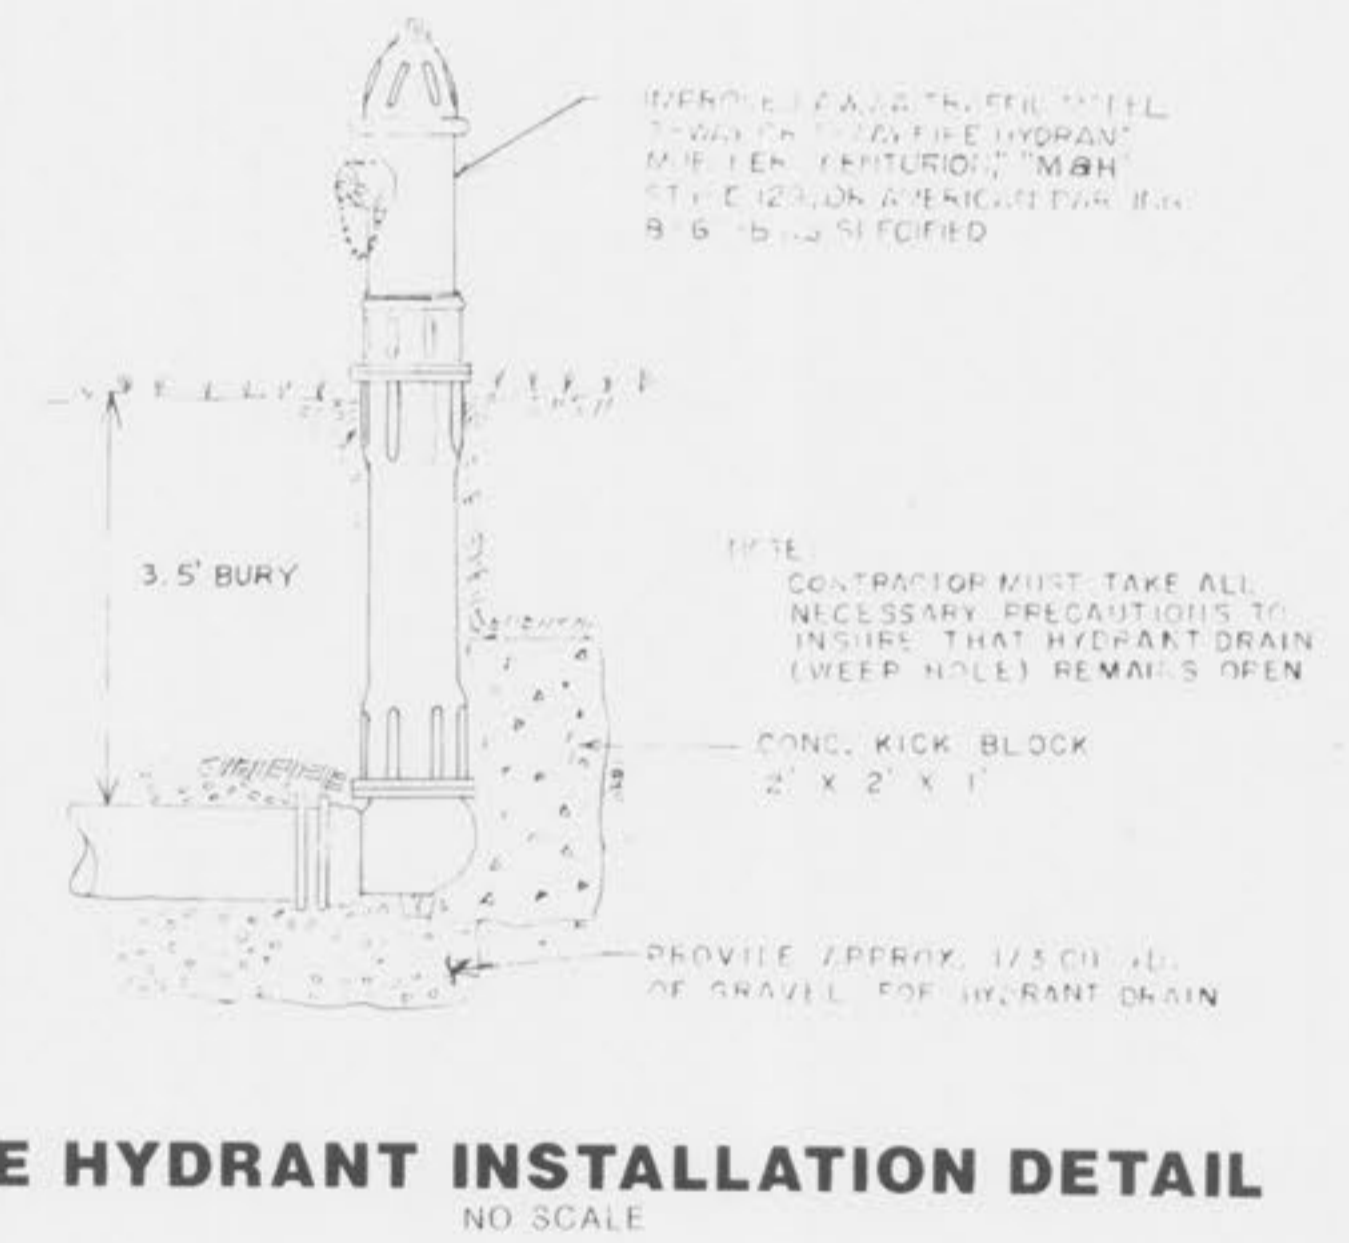


TYPICAL WATER MAIN INSTALLATION DETAILS
 NO SCALE

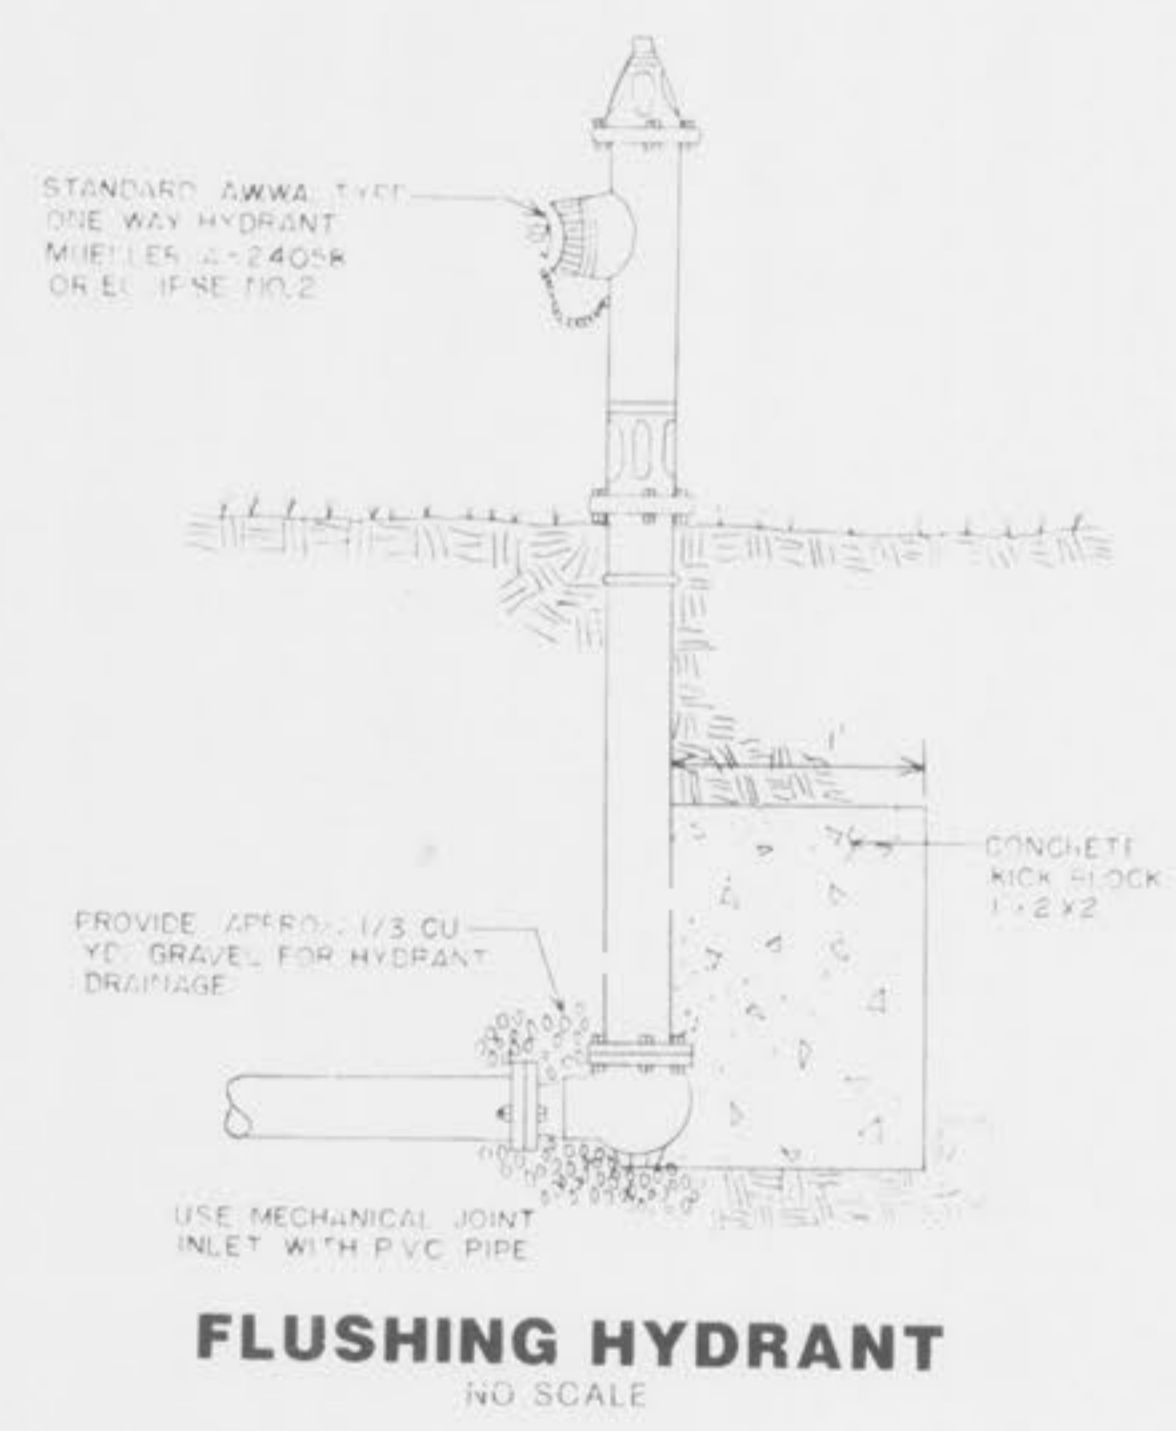

MAIN SIZE (DIAMETERS)	MIN. THRUST BLOCK CLEARING DIMENSIONS TO BEAR AGAINST UNDISTURBED EARTH				
	45° BEND	22 1/2° BEND	T-JE	VALVE	CROSS
2"	1.5' x 1'	1.5' x 1'	1.5' x 1'	1.5' x 1'	1.5' x 1'
4"	1.5' x 1'	1' x 1'	2' x 1'	2' x 1'	1' x 1'
6"	1.5' x 1'	1' x 1'	2' x 1'	2' x 1'	1' x 1'
8"	2' x 1'	1' x 1'	2' x 2.5'	2' x 2'	1' x 1.5'
10"	2' x 2.5'	1.5' x 2.5'	2' x 3.5'	2' x 3'	2' x 2'
12"	2' x 3.5'	1.5' x 3.5'	3' x 3.5'	3' x 3'	2' x 2'
16"	3' x 4'	2' x 3'	4' x 4.5'	3' x 4.5'	3' x 3.5'

12/13

ST. CHARLES COUNTY
 PUBLIC WATER SUPPLY DISTRICT
 NO. 2

Revised from Drawing by: COCHRAN ENGINEERING COMPANY, WASHINGTON, MISSOURI

APPROVED:

TYPICAL WATER INSTALLATION DETAILS

DATE: FEB. 88 SCALE: AS SHOWN SHEET NO. REVISIONS: