
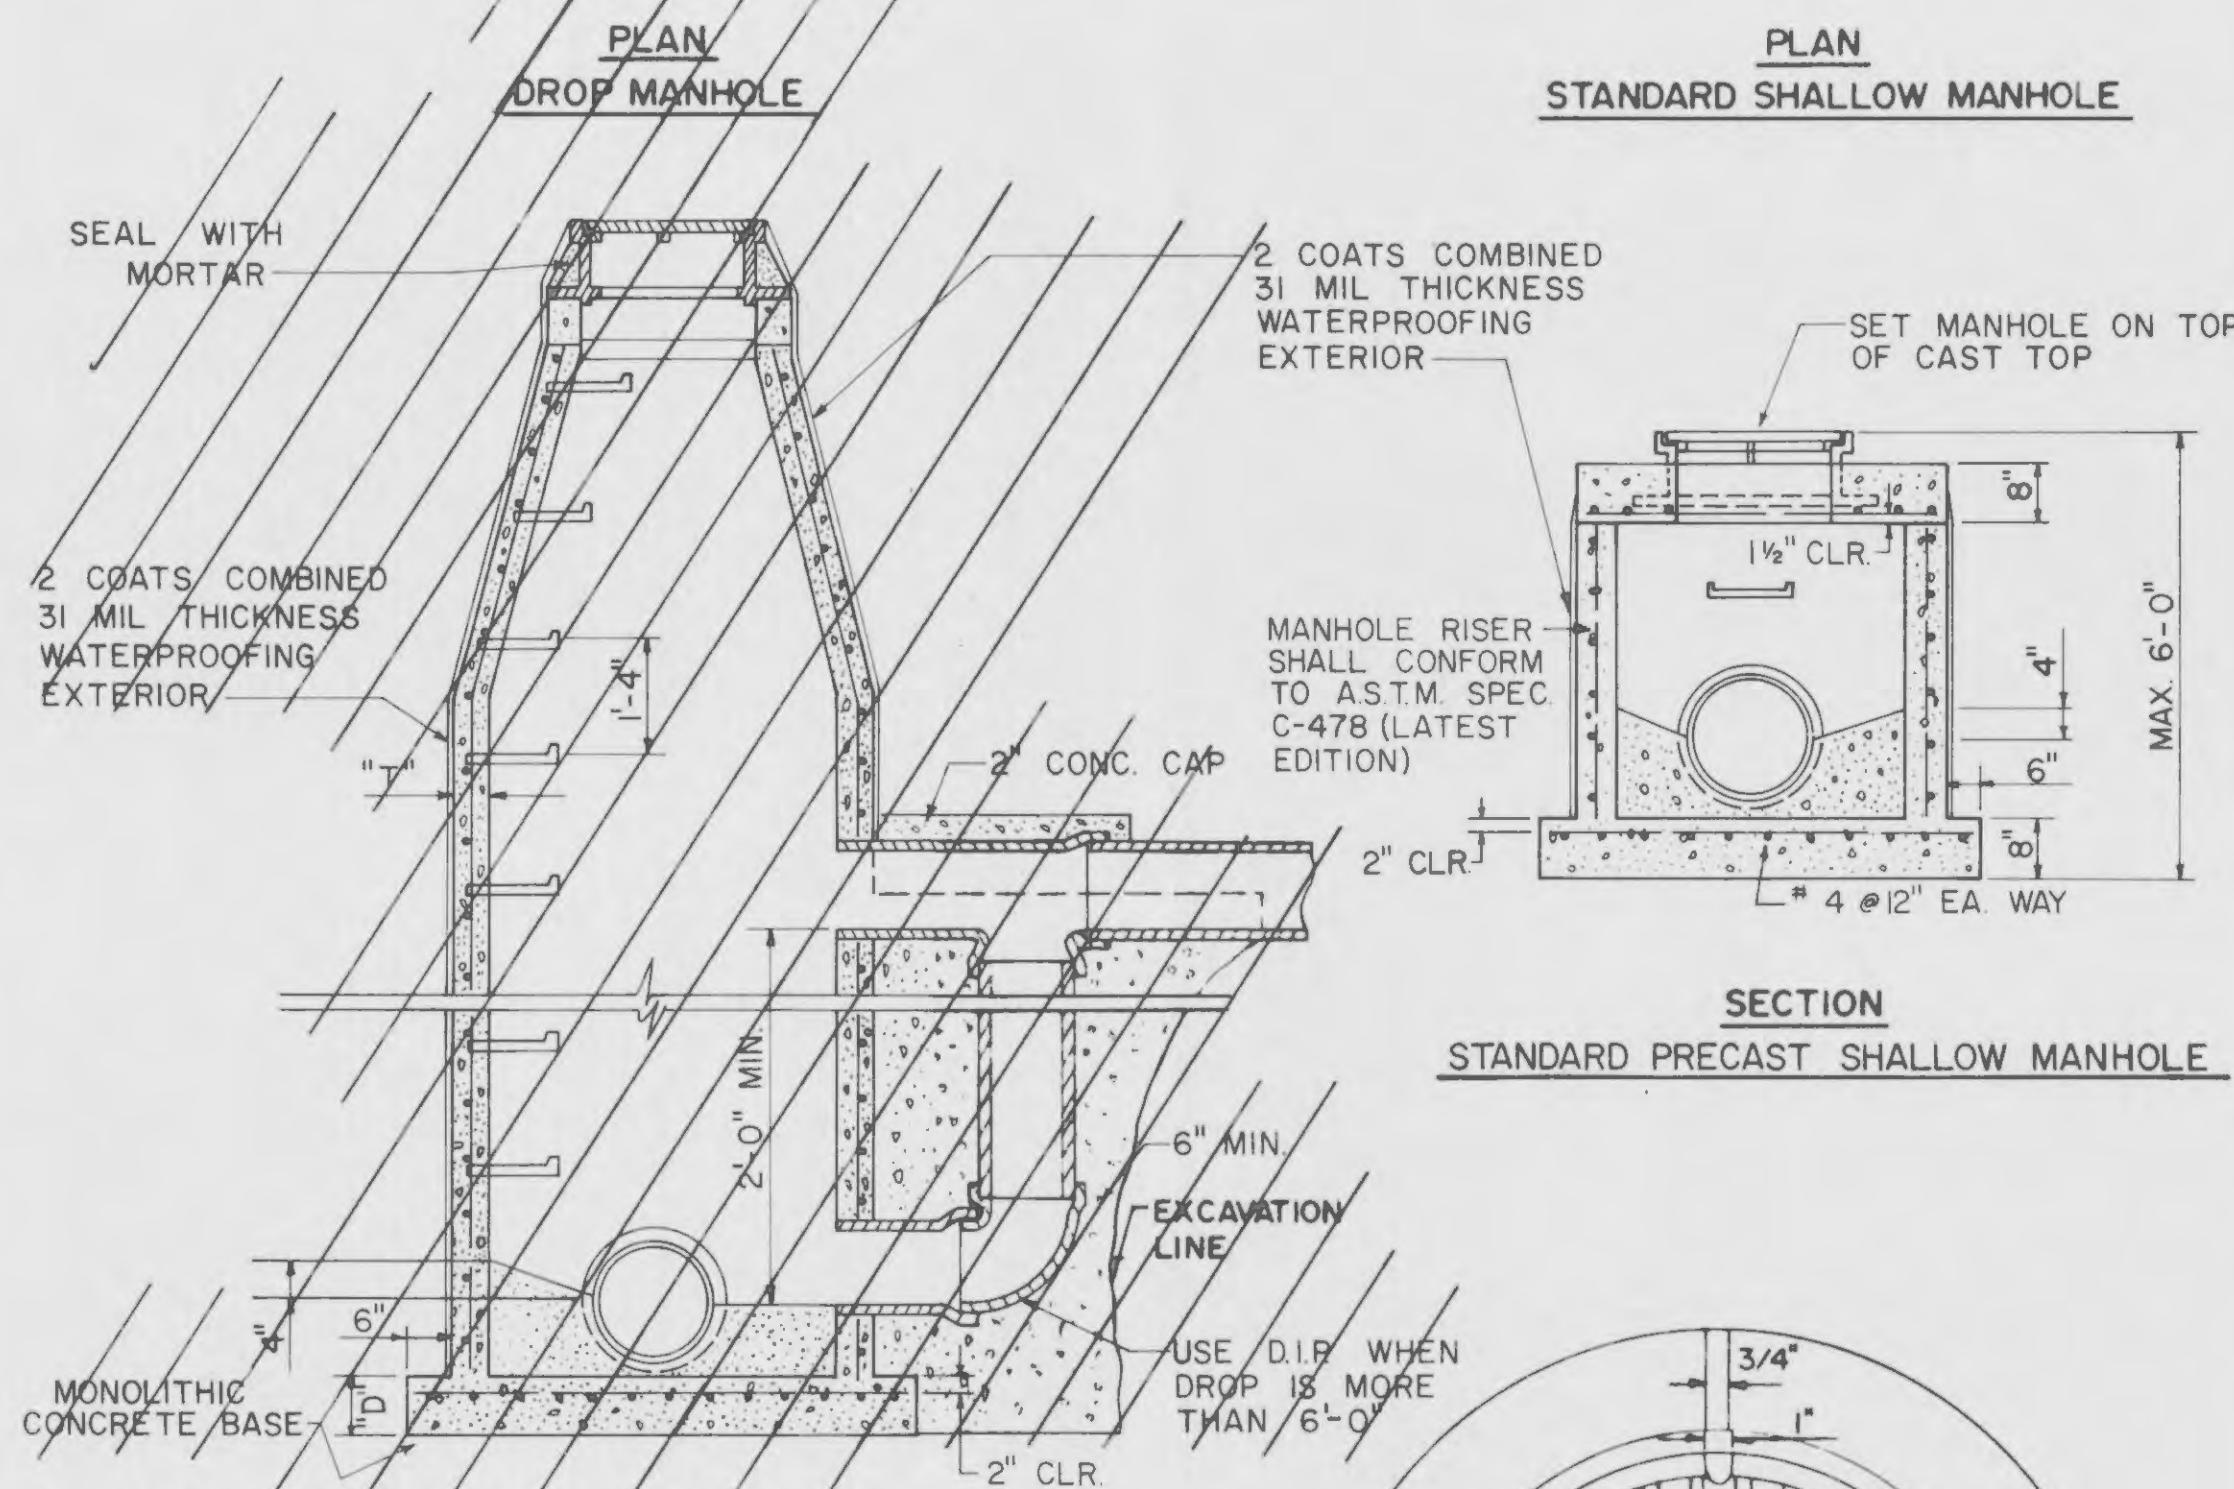
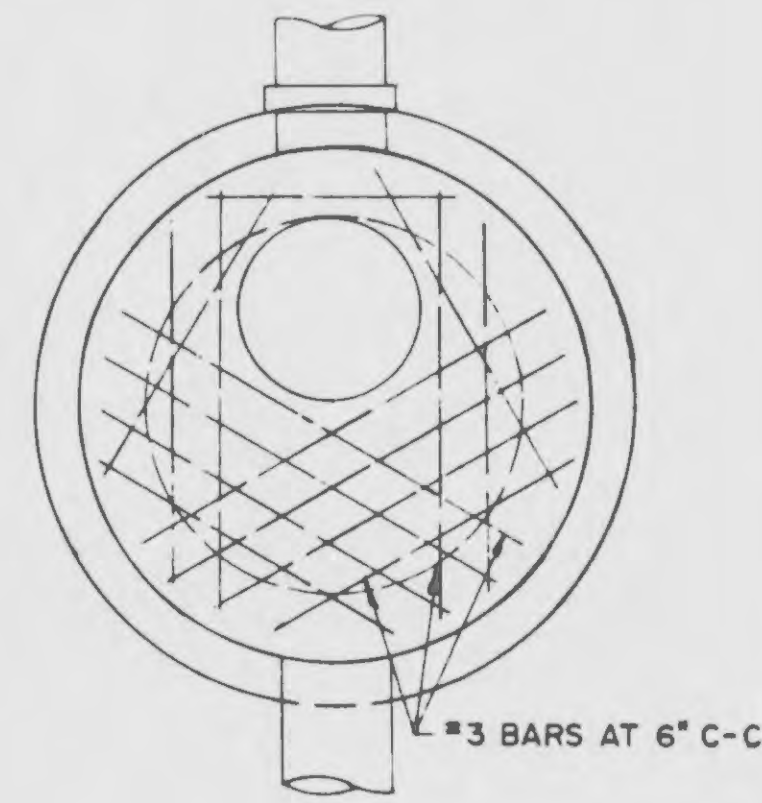
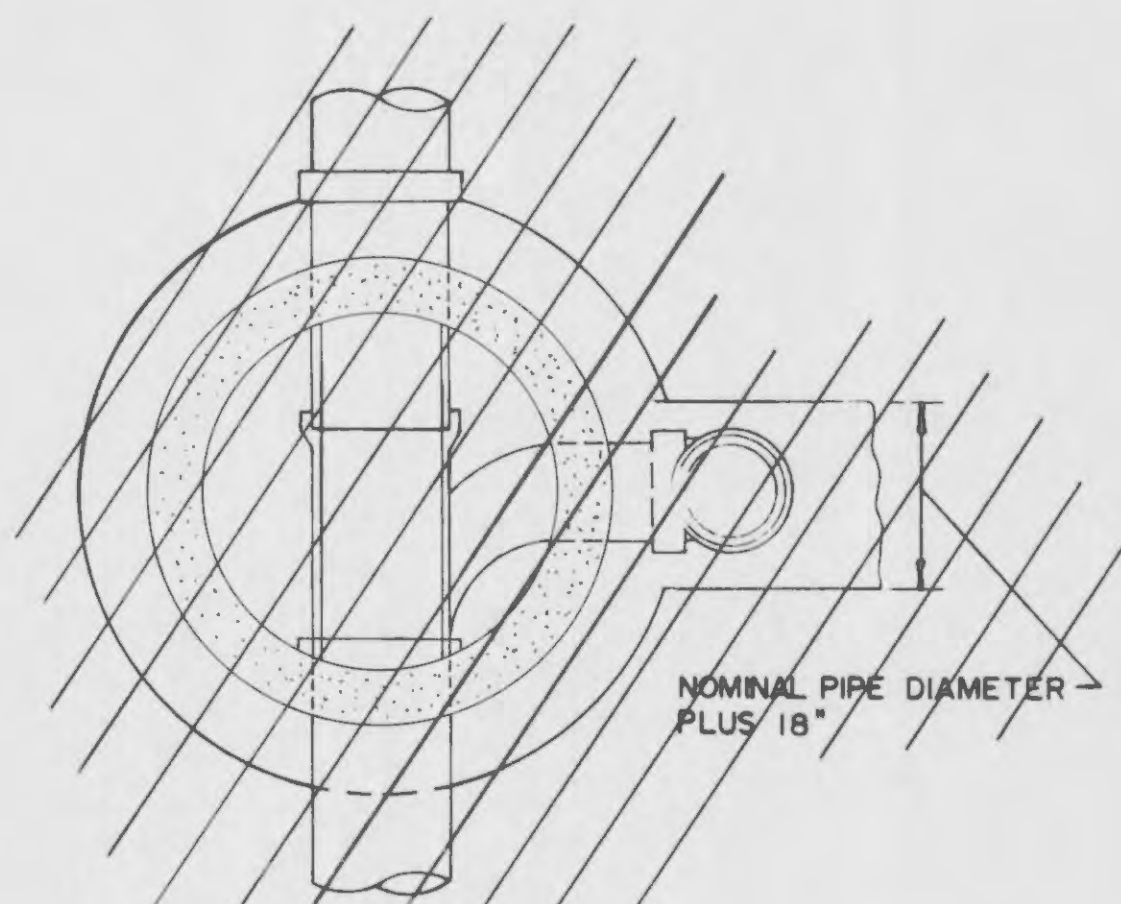



| WALL THICKNESS | |
|----------------|-------------------|
| DIA. M.H. | "T" DIM. PRE CAST |
| 48" | 5" |
| 60" | 6" |
| 72" | 7" |

| MANHOLE BASE THICKNESS | |
|------------------------|-------------------------------------|
| DEPTH (FEET) | "D" DIM. |
| 0-20 | 8" w/ #4 BARS @ 12" CTRS. EACH WAY |
| 20-30 | 8" w/ #4 BARS @ 9" CTRS. EACH WAY |
| 30-40 | 10" w/ #5 BARS @ 10" CTRS. EACH WAY |

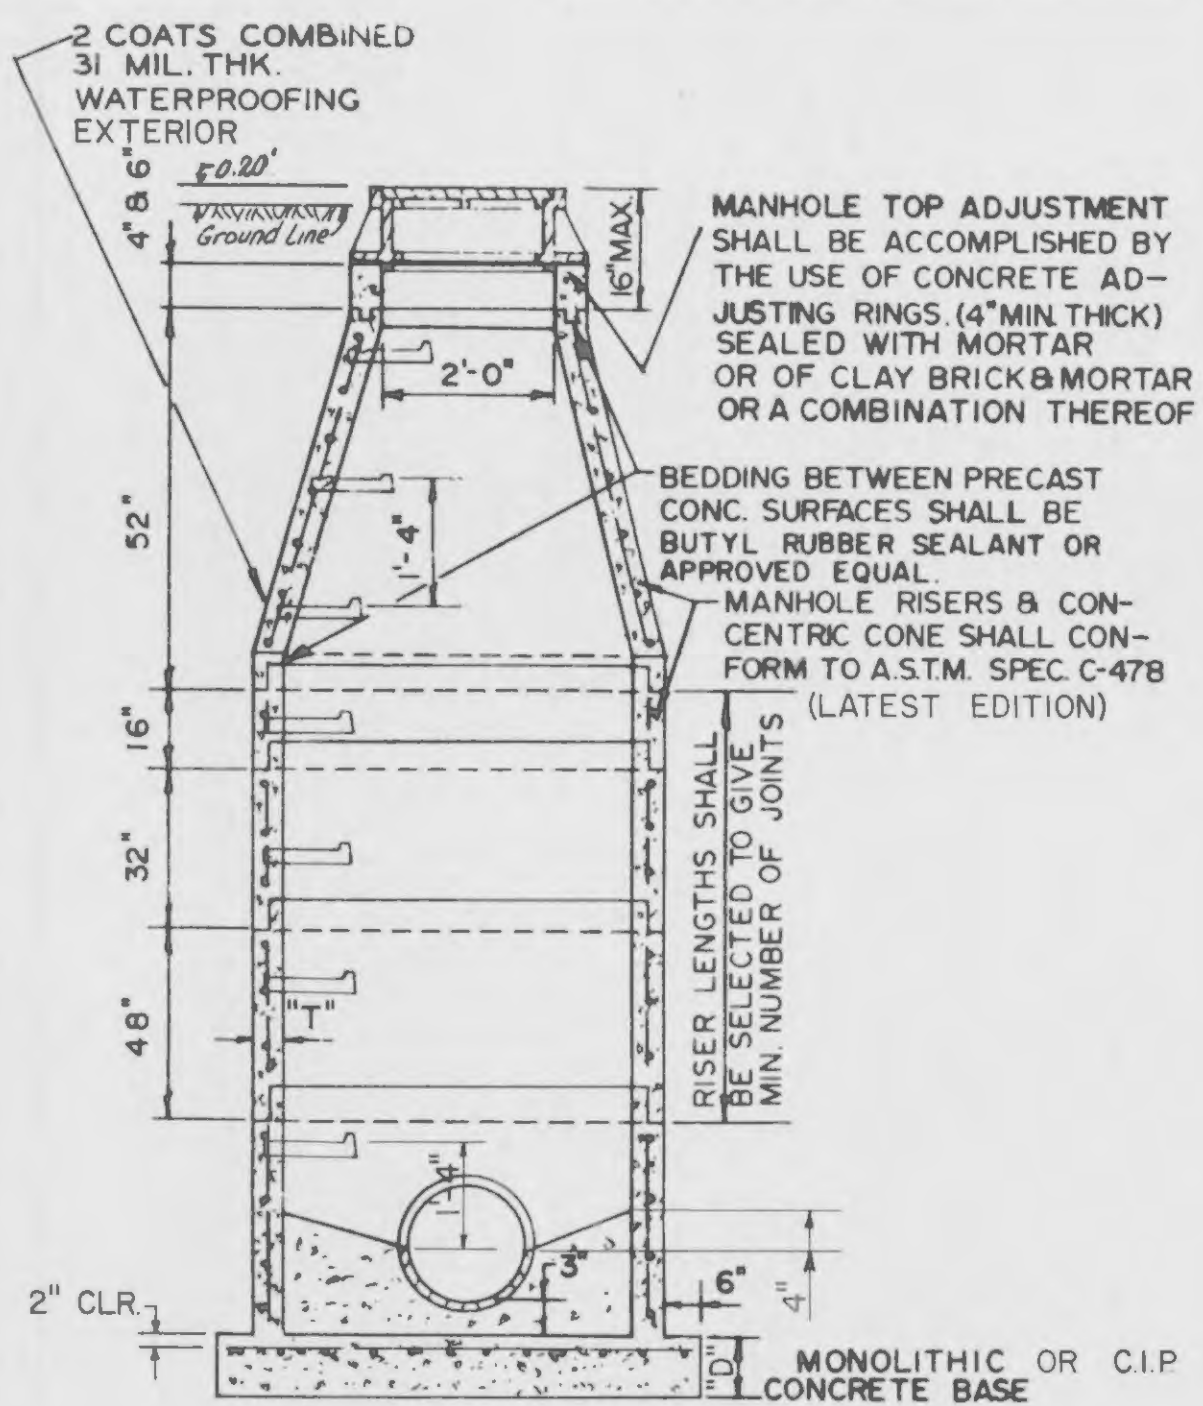


SECTION DROP MANHOLE


SECTION STANDARD PRECAST SHALLOW MANHOLE

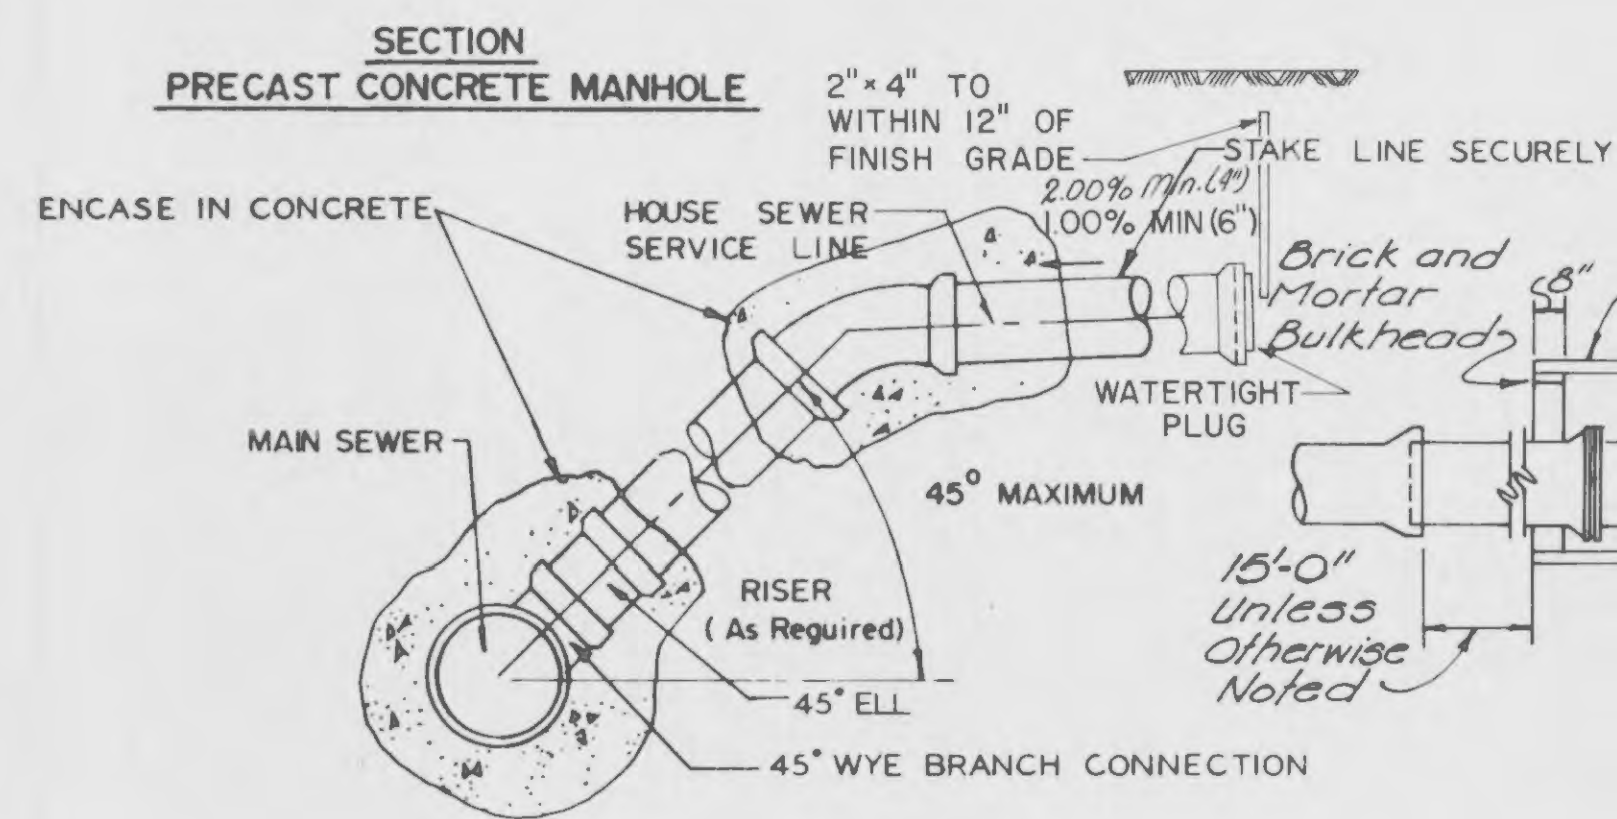

SECTION SEWER SERVICE CONNECTION

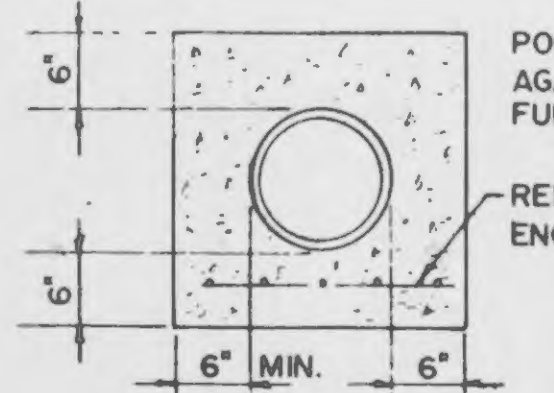


CONCRETE ENCASUREMENT

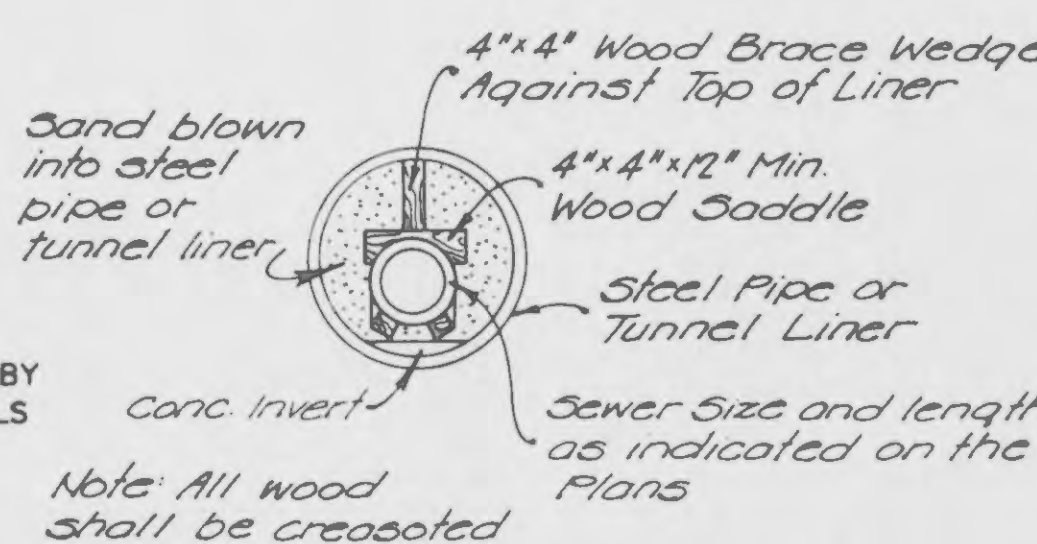

DETAIL OF CROSSING IN CONDUIT

NOTES:


1. ANY MATERIAL EXCAVATED BENEATH PIPE ENTERING OR LEAVING MANHOLES SHALL BE REPLACED WITH CONCRETE.
2. ALL MANHOLE RINGS AND ADJUSTING RINGS SHALL BE SET IN MORTAR.
3. INSIDE DIAMETER OF MANHOLES TO BE 4'-0" FOR PIPE 21" & SMALLER, 5'-0" FOR PIPE 24" THRU 30", 6'-0" FOR PIPE OVER 30"
4. PLASTERING OF INSIDE OF MANHOLES SHALL BE THE OPTION OF THE CONTRACTOR.
5. ALL SEWERS EXTENDING FROM MANHOLES SHALL BE SUPPORTED WITH CONCRETE TO FIRST JOINT.
6. CONTRACTOR SHALL BE PAID FOR 6" CONCRETE ENCASUREMENT AROUND PIPE AS SHOWN IN DETAIL.
7. LAMP LINES BEFORE AND AFTER INSTALLATION OF CONCRETE ENCASUREMENT.
8. PRECAST MANHOLE SHALL BE WATERPROOFED OUTSIDE.
9. ALL CONC. MANHOLES TO HAVE RUBBER GASKET ON ALL PIPE OPENINGS.

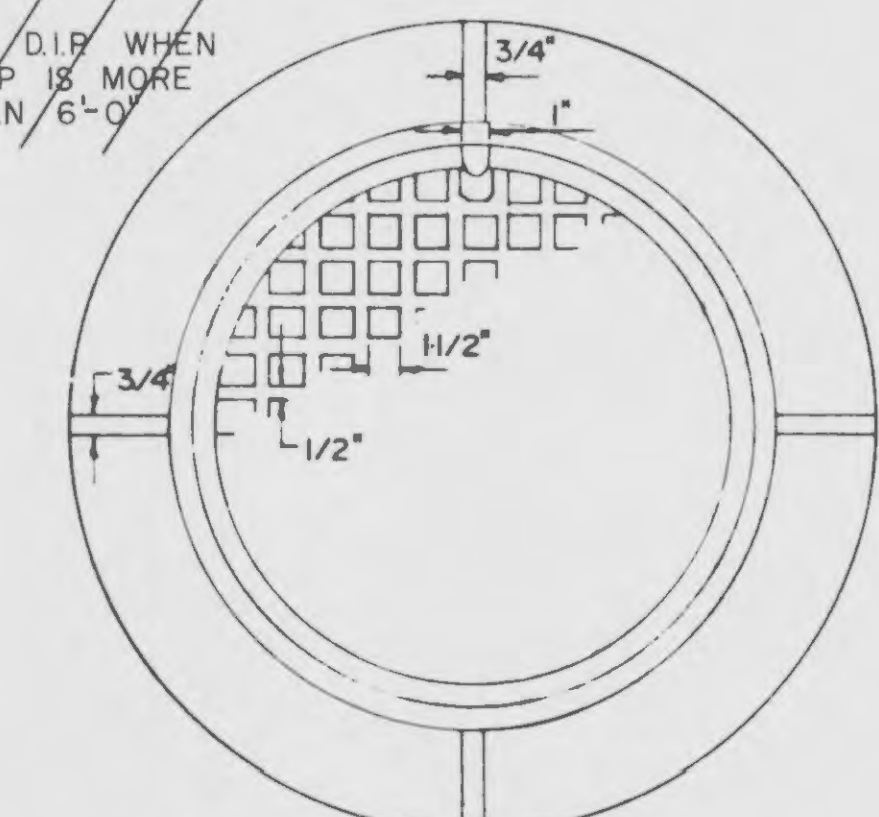

STANDARD MANHOLE RING AND COVER

CLAY & BAILEY - NO. 2008

DEETER OR EQUAL 1315

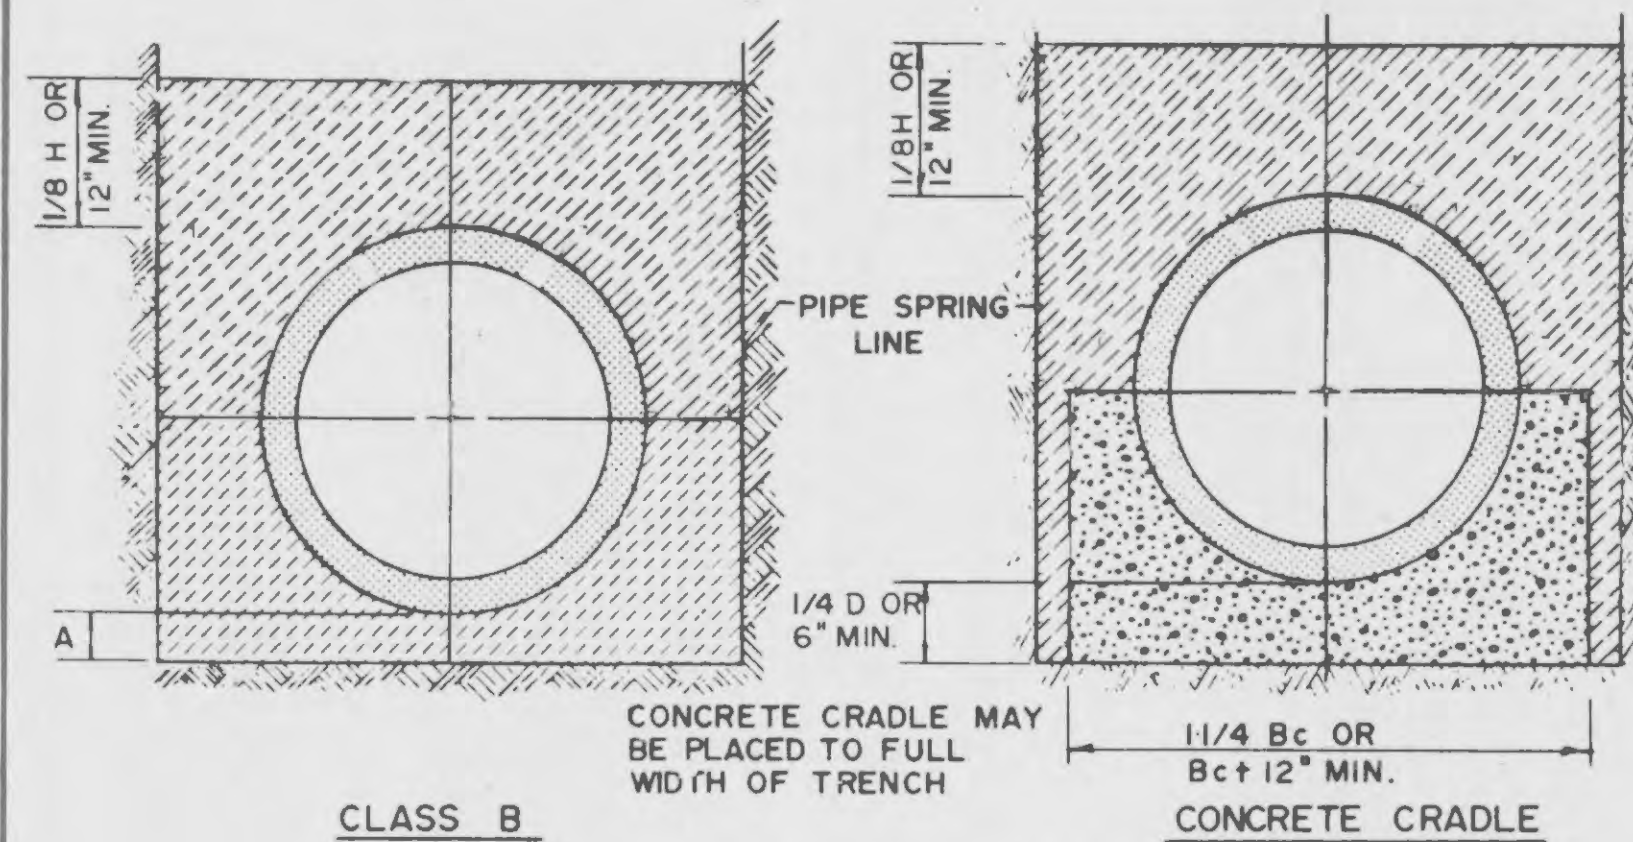

CLASS B

BEDDING DETAILS

- LEGEND:
- Bc OUTSIDE DIA. OF PIPE
 - H BACKFILL COVER ABOVE TOP OF PIPE
 - D NOMINAL PIPE SIZE
 - A FILL BELOW PIPE (SEE TABLE BELOW)




- GRANULAR FILL
- CONCRETE

TABLE OF FILL BELOW PIPE


| D | A MIN. |
|---------------|--------|
| 27" & SMALLER | 3" |
| 30" TO 60" | 4" |
| 66" & LARGER | 6" |

NOTES:


1. GRANULAR FILL TO BE CRUSHE'D STONE OR PEA GRAVEL WITH NOT LESS 95% PASSING 1/2" AND NOT LESS THAN 95% TO BE RETAINED ON A #4, TO BE PLACED IN NOT MORE THAN 6" LAYERS AND COMPACTED BY SLICING WITH A SHOVEL. (1/2" & #4 REFERS TO SIEVE SIZE.)
2. TAMPED BACKFILL SHALL BE FINELY DIVIDED JOB EXCAVATED MATERIAL FREE FROM DEBRIS, ORGANIC MATERIAL AND STONES, COMPACTED TO 95% MAXIMUM DENSITY AS DETERMINED BY AASHO STANDARD METHOD T-99. GRANULAR FILL MAY BE SUBSTITUTED FOR TAMPED BACKFILL TO TOP OF THE PIPE.
3. HAND PLACED BACKFILL SHALL BE FINELY DIVIDED MATERIAL FREE FROM DEBRIS AND STONES.
4. ALL BEDDING DETAILS APPLY TO BUILDING SEWER SERVICE LINES AS WELL AS OTHER SEWERS.
5. CONCRETE CRADLE SHALL BE USED WHEN TRENCH WIDTH EXCEEDS 24" PLUS THE PIPE DIAMETER.
6. PVC PIPE SHALL BE BEDDED IN ACCORDANCE WITH ASTM D 2321 USING CLASS 1 (3/4" TO 1/4") GRANULAR MATERIAL.

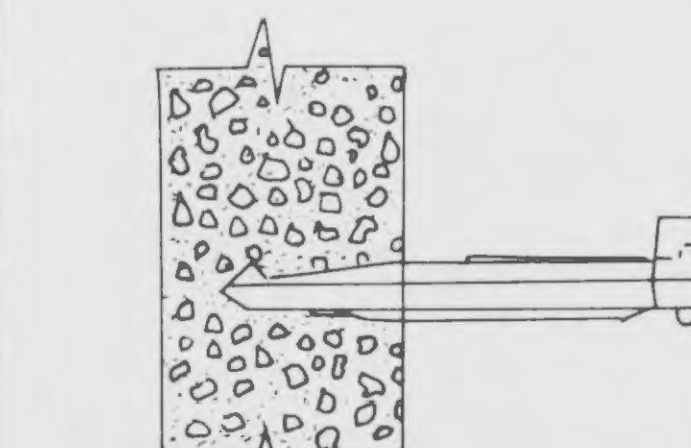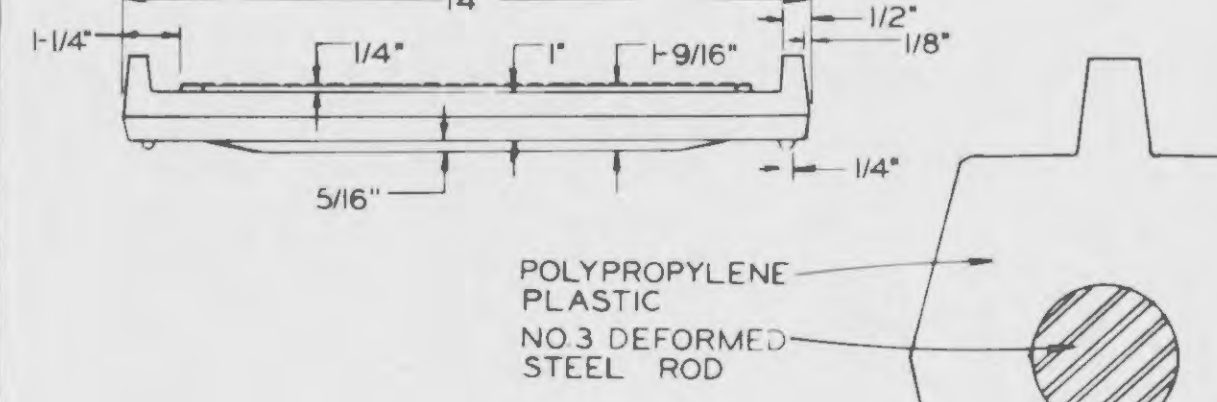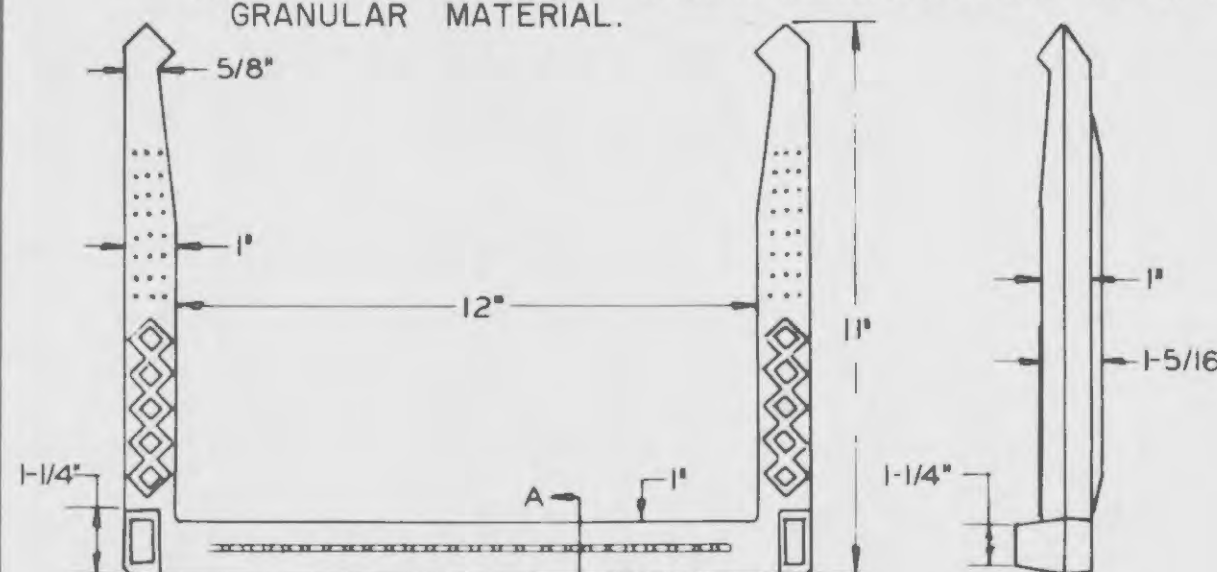

MANHOLE STUBOUT

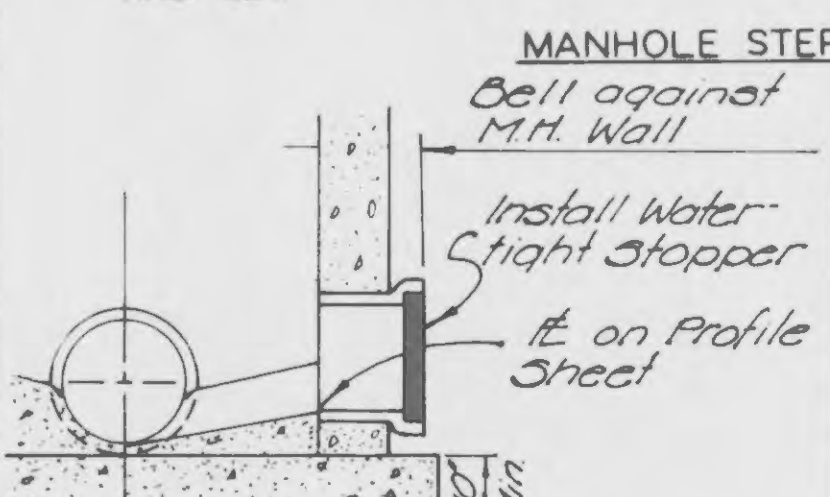

MANHOLE STUBOUT

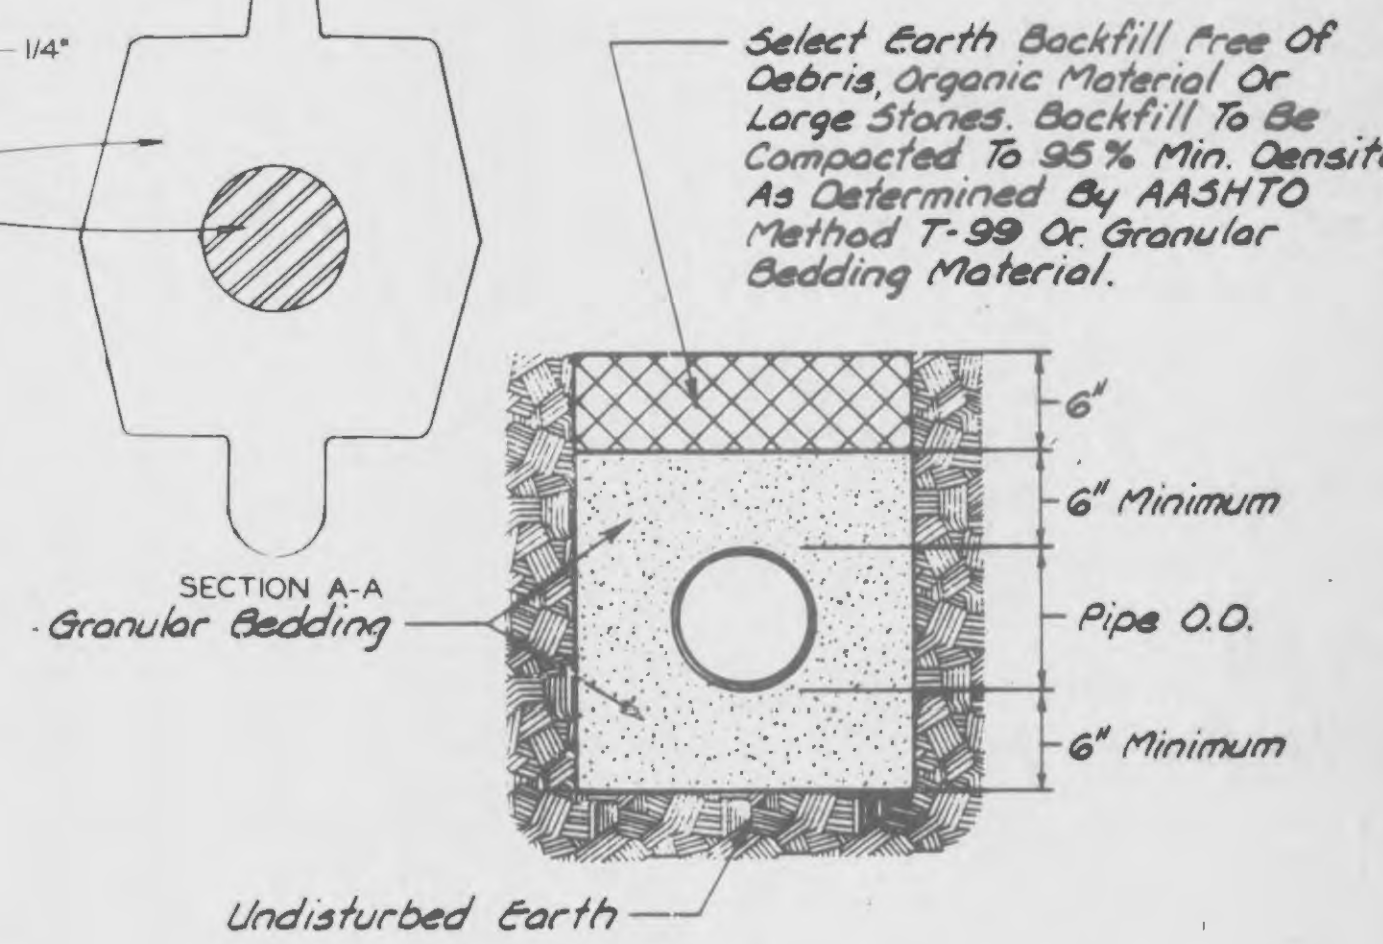

FLEXIBLE PIPE BEDDING DETAIL

GBA
GEORGE BUTLER ASSOCIATES
CONSULTING ENGINEERS ARCHITECTS
LANDSCAPE ARCHITECTS PLANNERS

K-LAND
SANITARY SEWER DETAILS

| | | |
|-------------------|---------------|-------------------|
| DESIGNED BY Std. | DRAWN BY Std. | CHECKED BY G.R.H. |
| JOB NO 4576 | DATE 8-27-87 | SCALE AS SHOWN |
| SHEET NO 14 OF 15 | | |