


40  
 HWY.  
 OLD

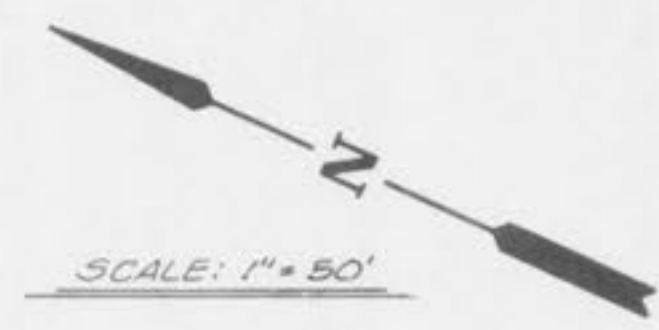

- NOTES:**
1. ALL FIRE HYDRANTS WILL BE 5' BEHIND BACK OF CURB.
  2. FOR TYPICAL INSTALLATION DETAILS, SEE SHEET 18 OF 18.
  3. ALL METER PITS WILL BE LOCATED WITHIN 2' OF THE BACK OF CURB OR WATER MAIN.
  4. ALL 2" BLOWOFF ASSEMBLIES WILL BE METAL.