



DATE
BY
REVIEWED
SURVEY
PLOTTED
NOTE BOOK
NO. 1
ANBAR CHECKED

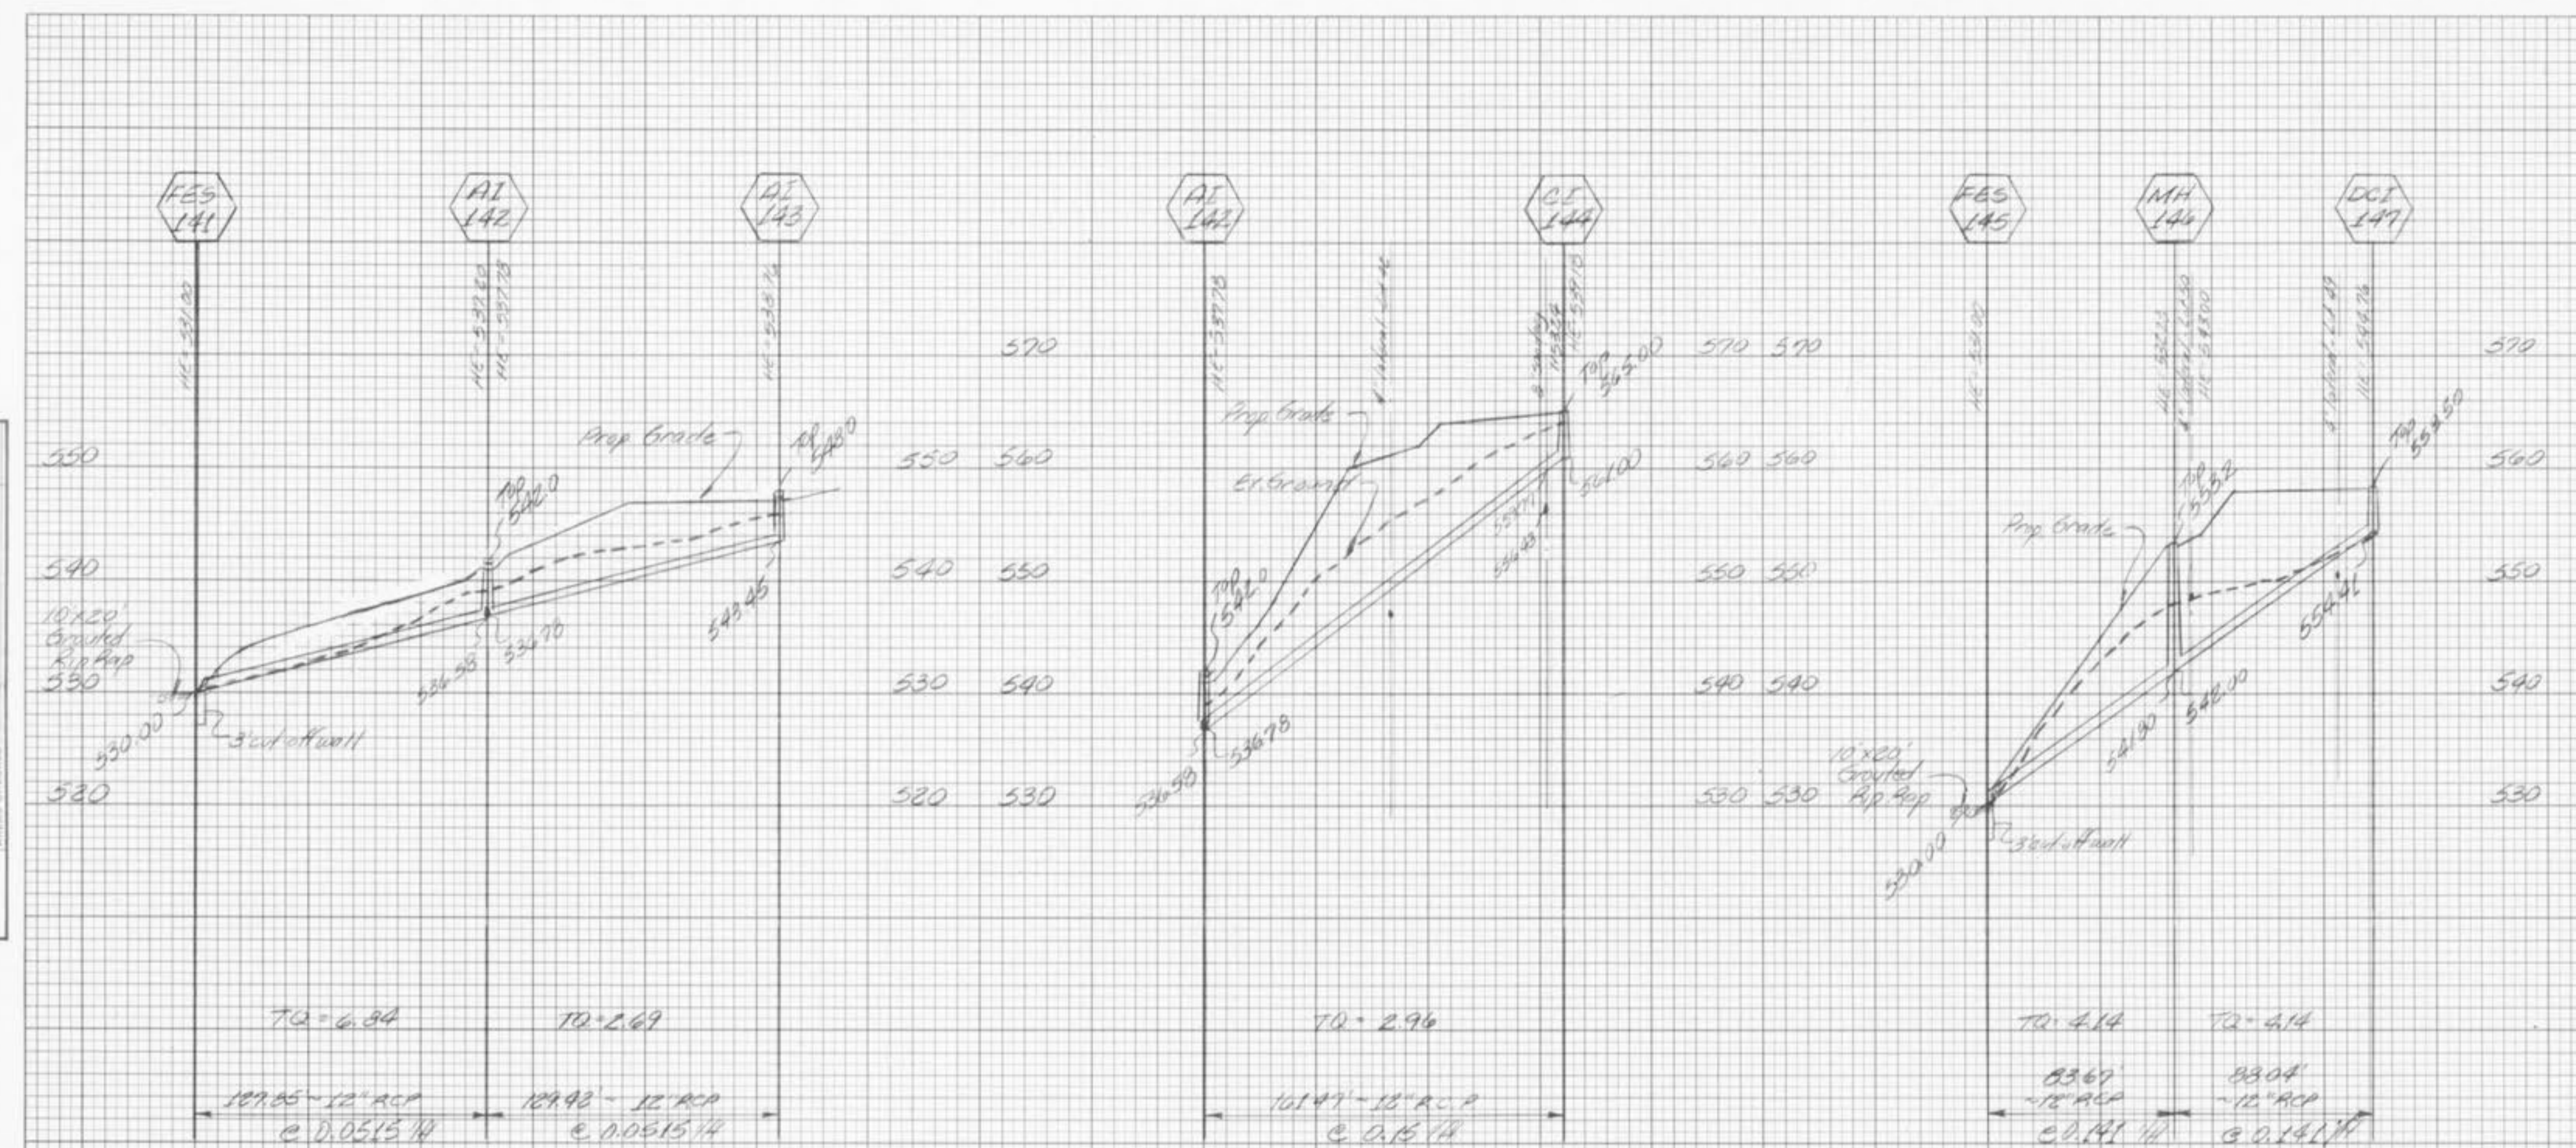

NOTE:
The use of high density polyethylene corrugated pipe will be permitted as an acceptable alternative to reinforced concrete pipe. Pipe shall meet A.S.T.M. D-2381 & AASHTO M-249-92. Concrete Flamed end sections and inlet structures shall be required. Pipe must have smooth interior wall and is not to be used inside the public right-of-way.
All concrete pipe shall be installed with O-Ring rubber type gaskets per M.S.D. Standard Construction Specifications.

DATE
BY
REVIEWED
SURVEY
PLOTTED
NOTE BOOK
NO. 1
ANBAR CHECKED

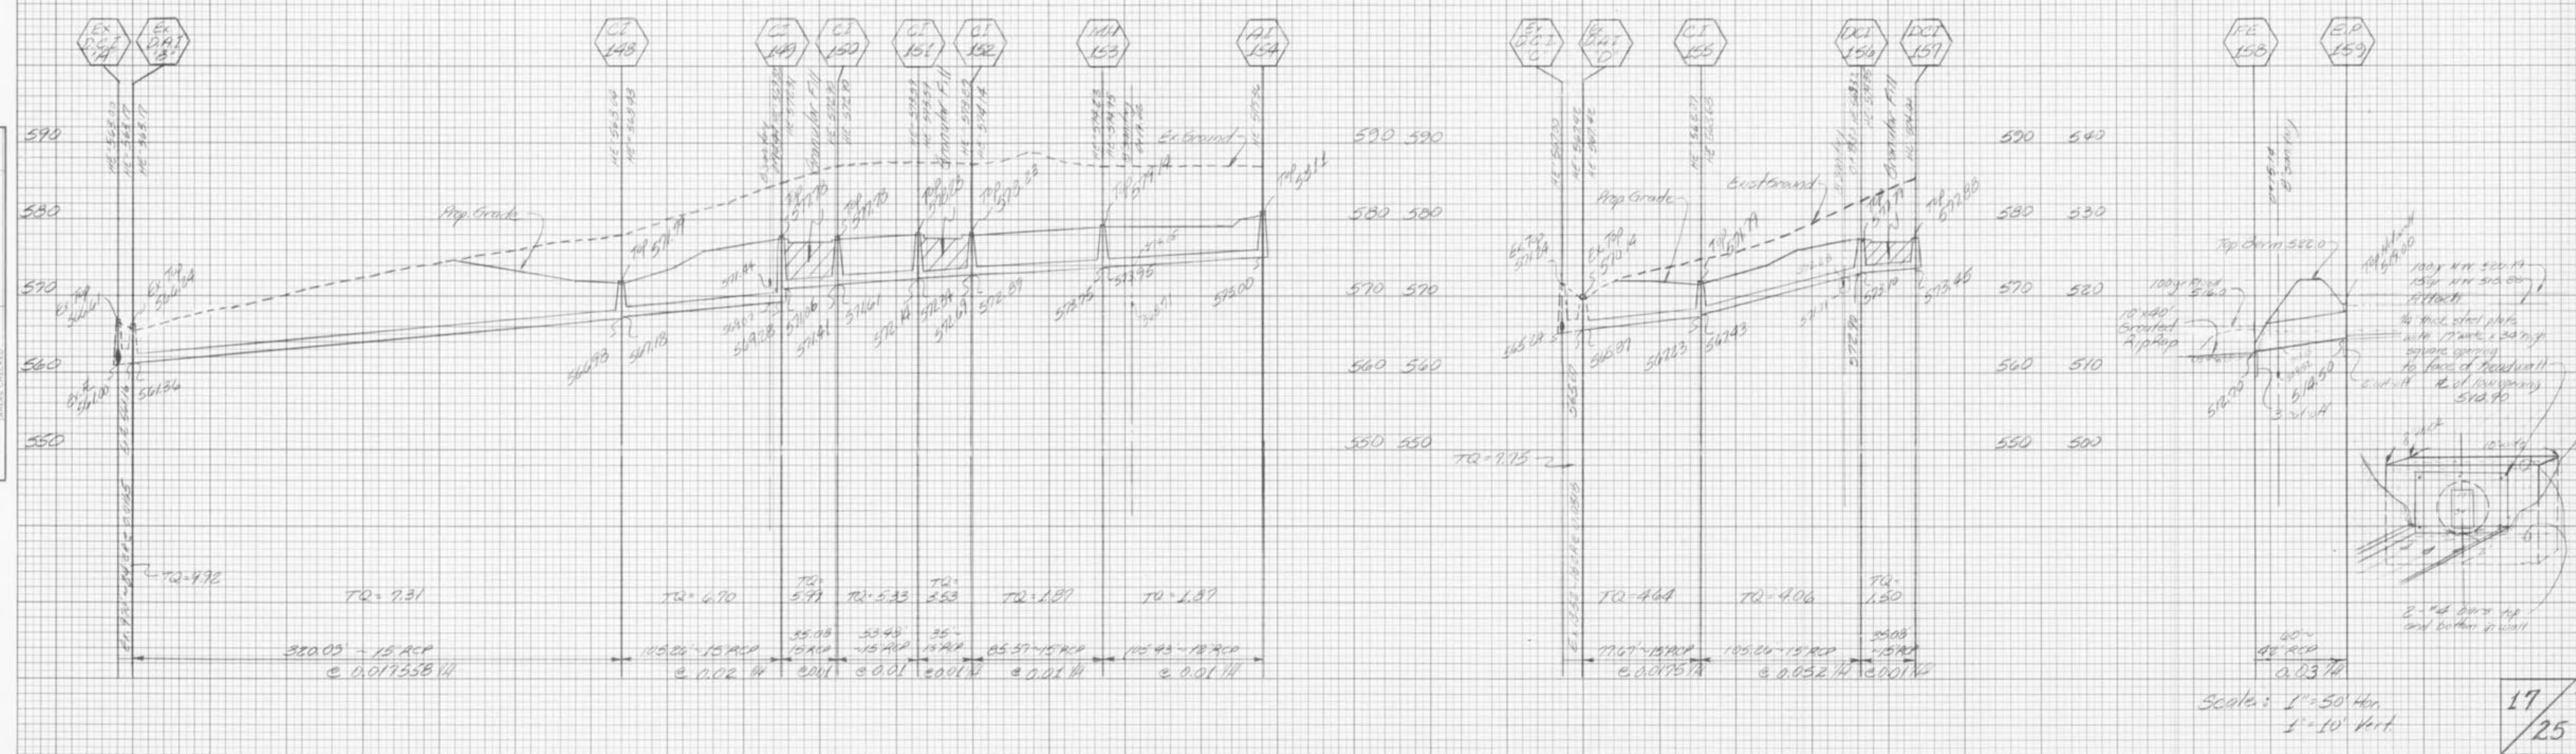

Scales: 1" = 50' Hor
1" = 10' Vert