




CL 4 THRU NDB 42  
SCALE - HORIZ. 1" = 30'  
VERT. 1" = 10'

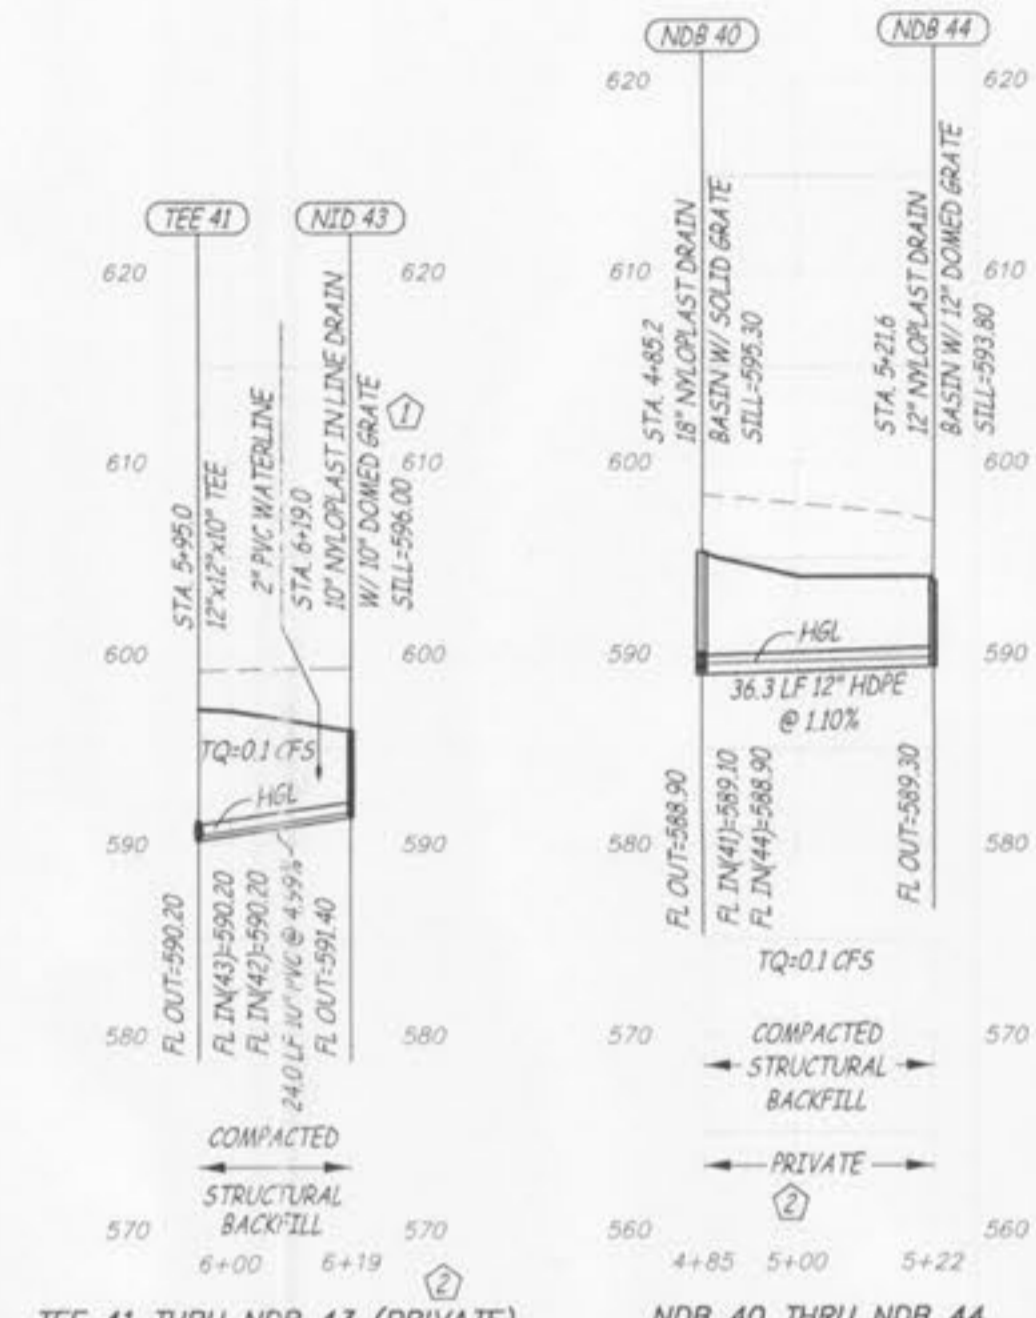


TEE 41 THRU NDB 43 (PRIVATE)  
SCALE - HORIZ. 1" = 30'  
VERT. 1" = 10'

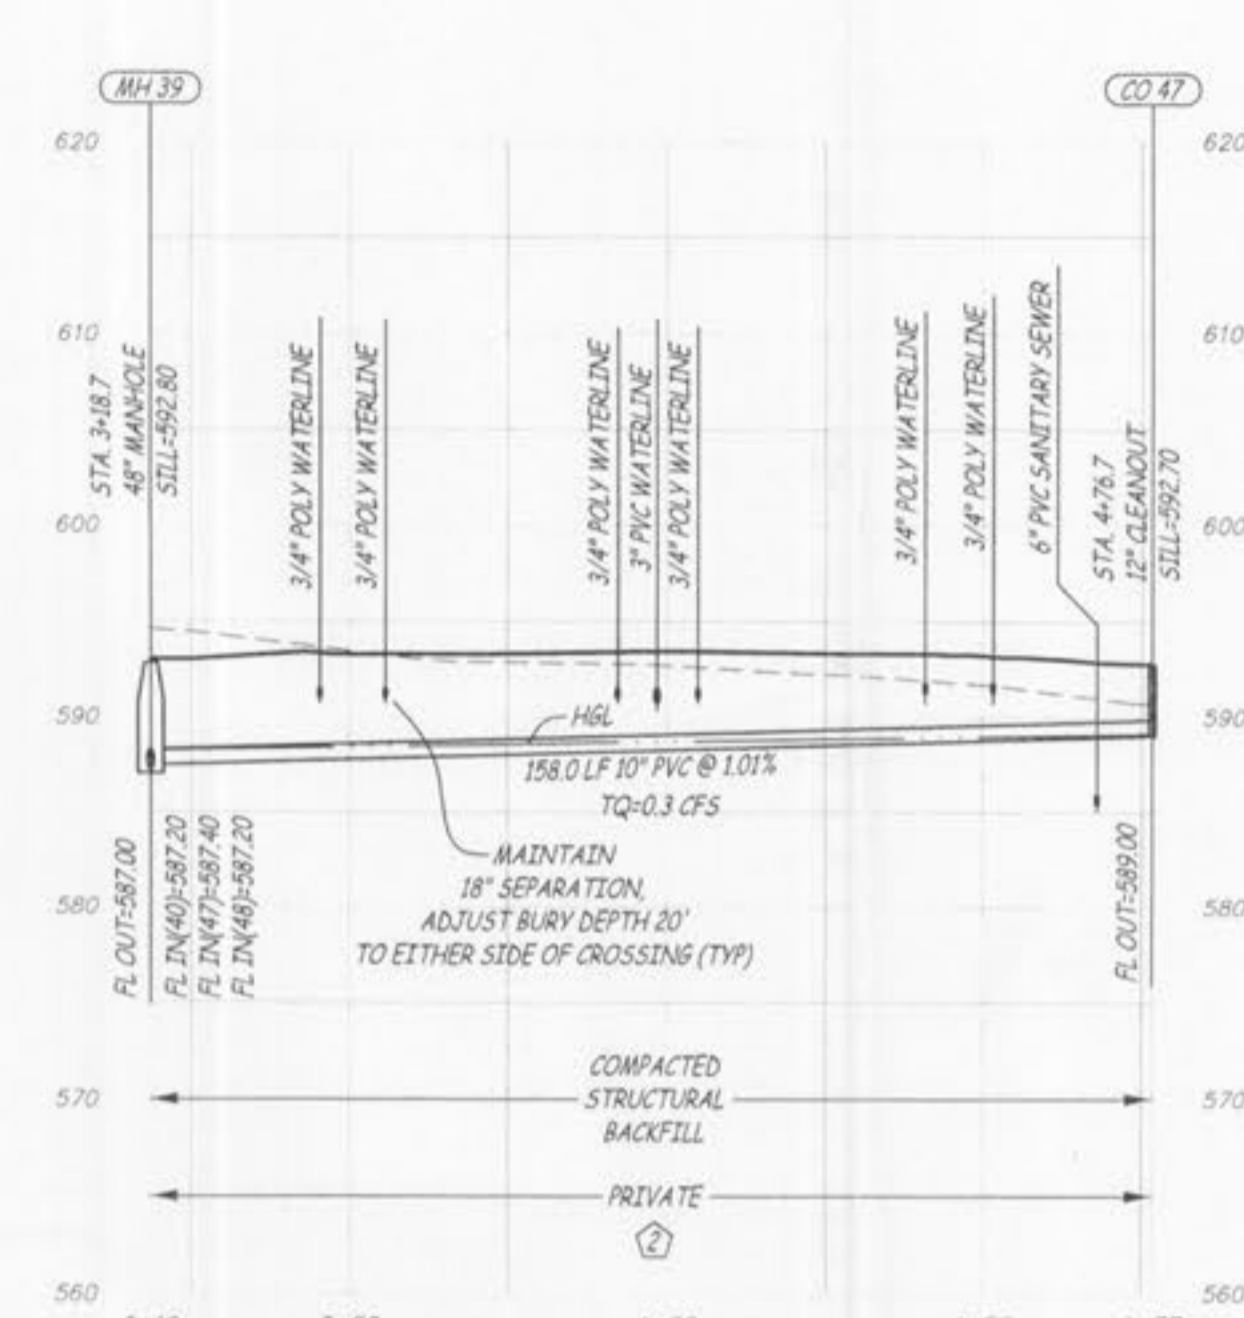


MH 39 THRU CO 47  
SCALE - HORIZ. 1" = 30'  
VERT. 1" = 10'

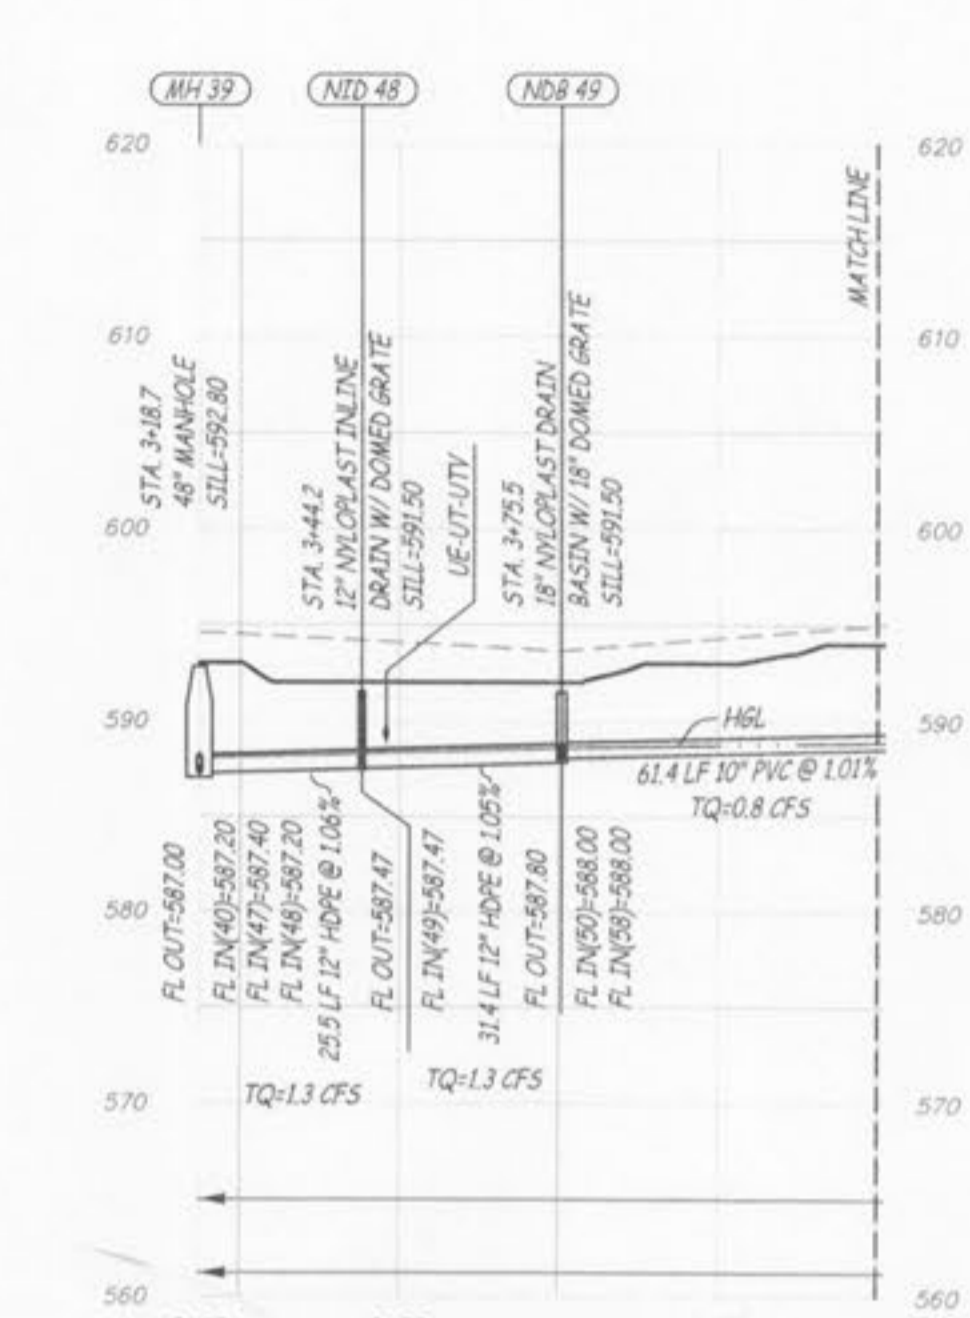


MH 39 THRU NDB 55  
SCALE - HORIZ. 1" = 30'  
VERT. 1" = 10'

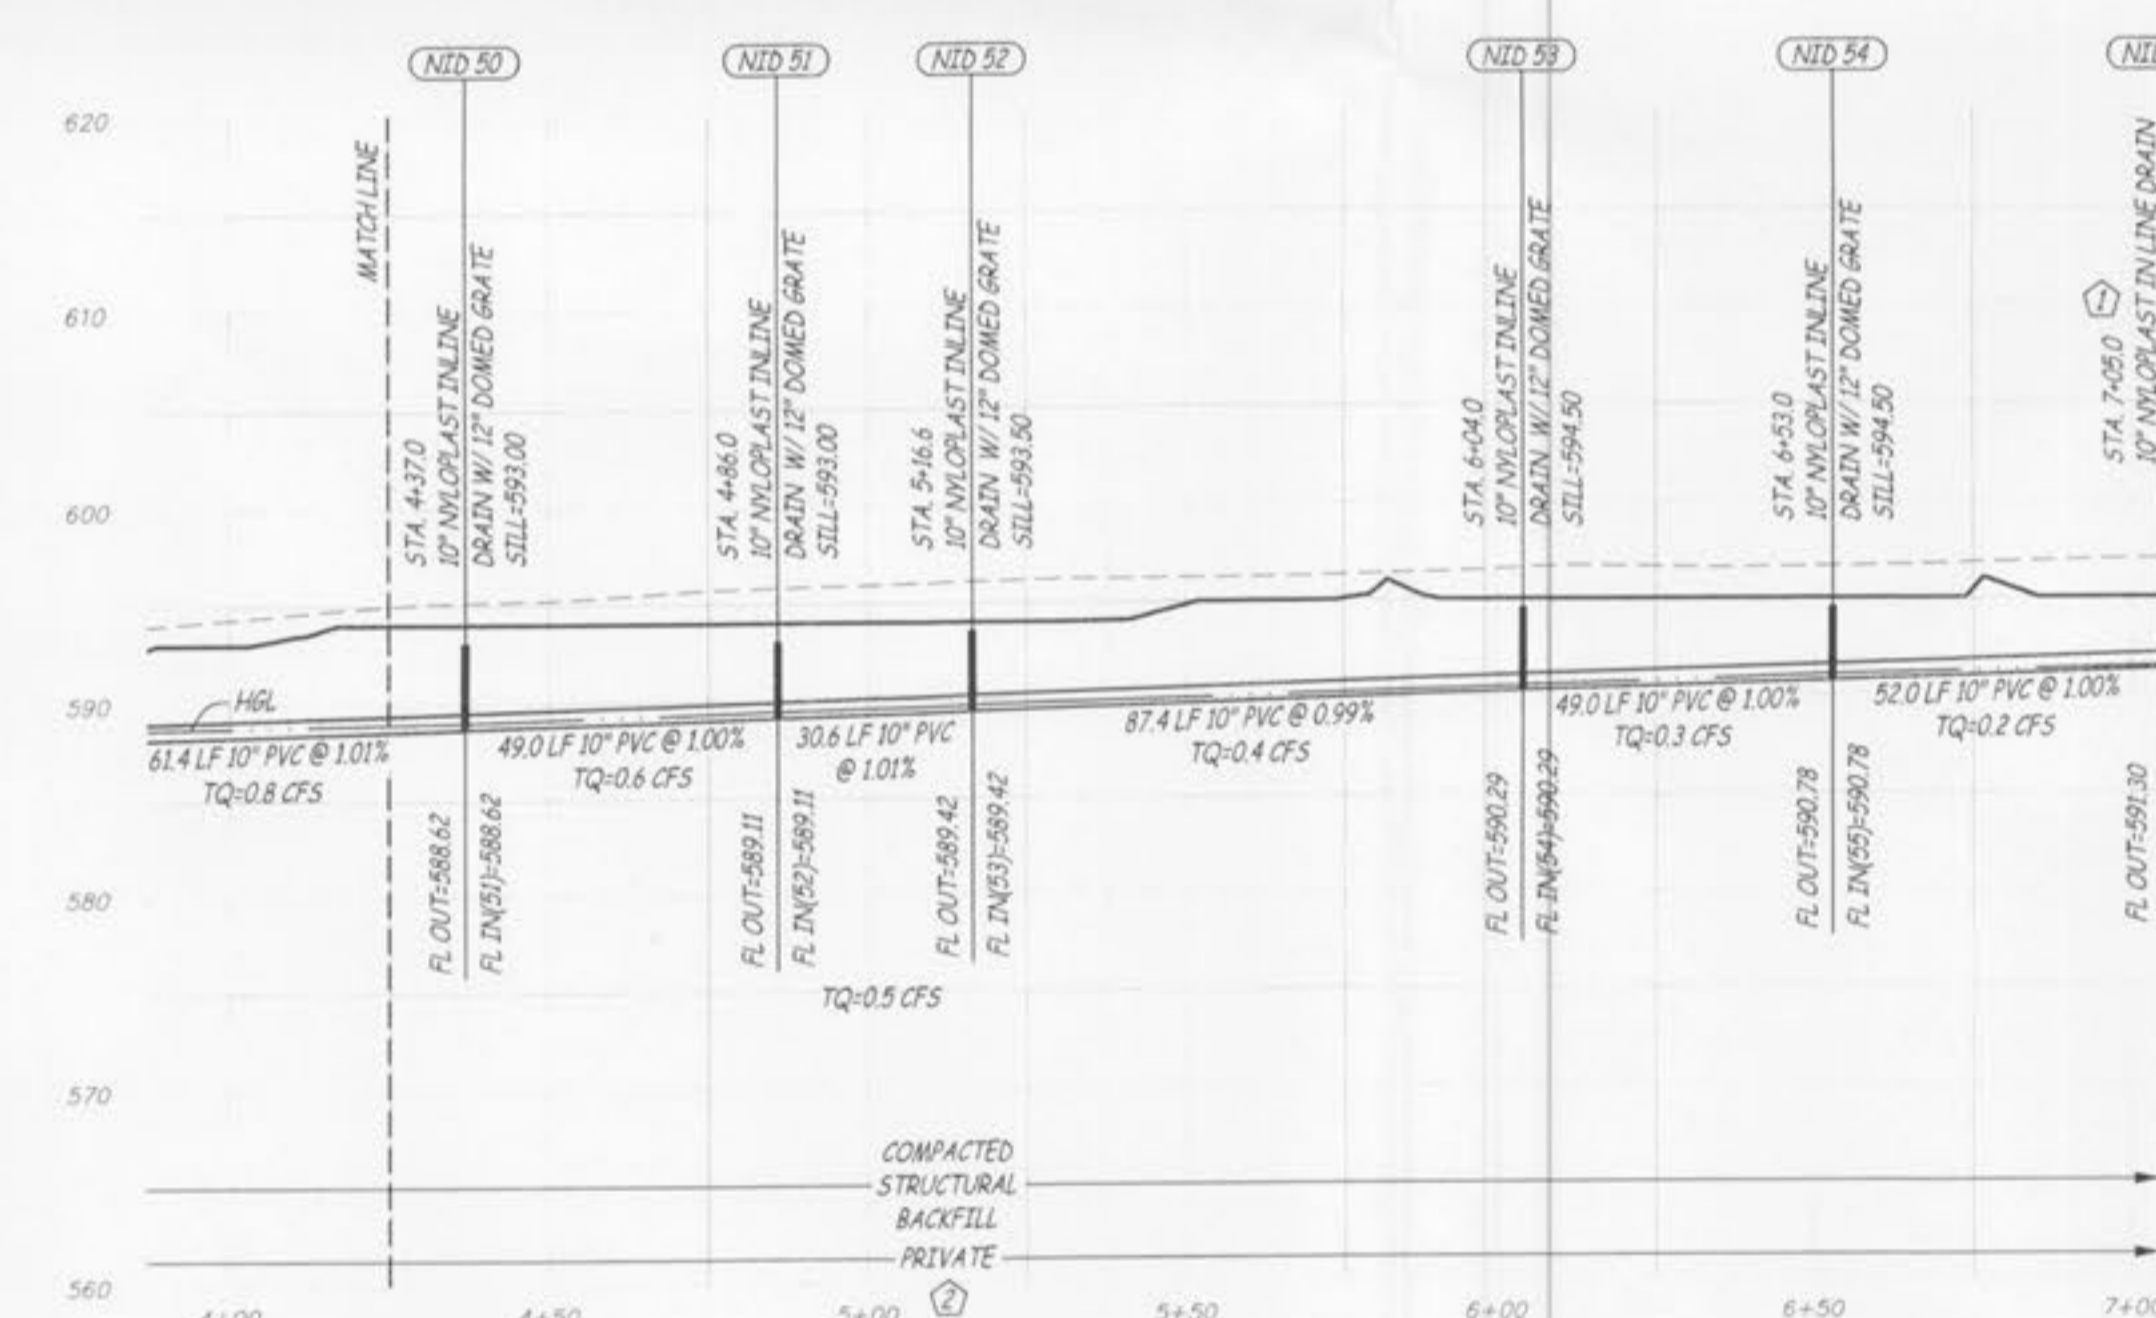

MH 39 THRU NDB 55  
SCALE - HORIZ. 1" = 30'  
VERT. 1" = 10'

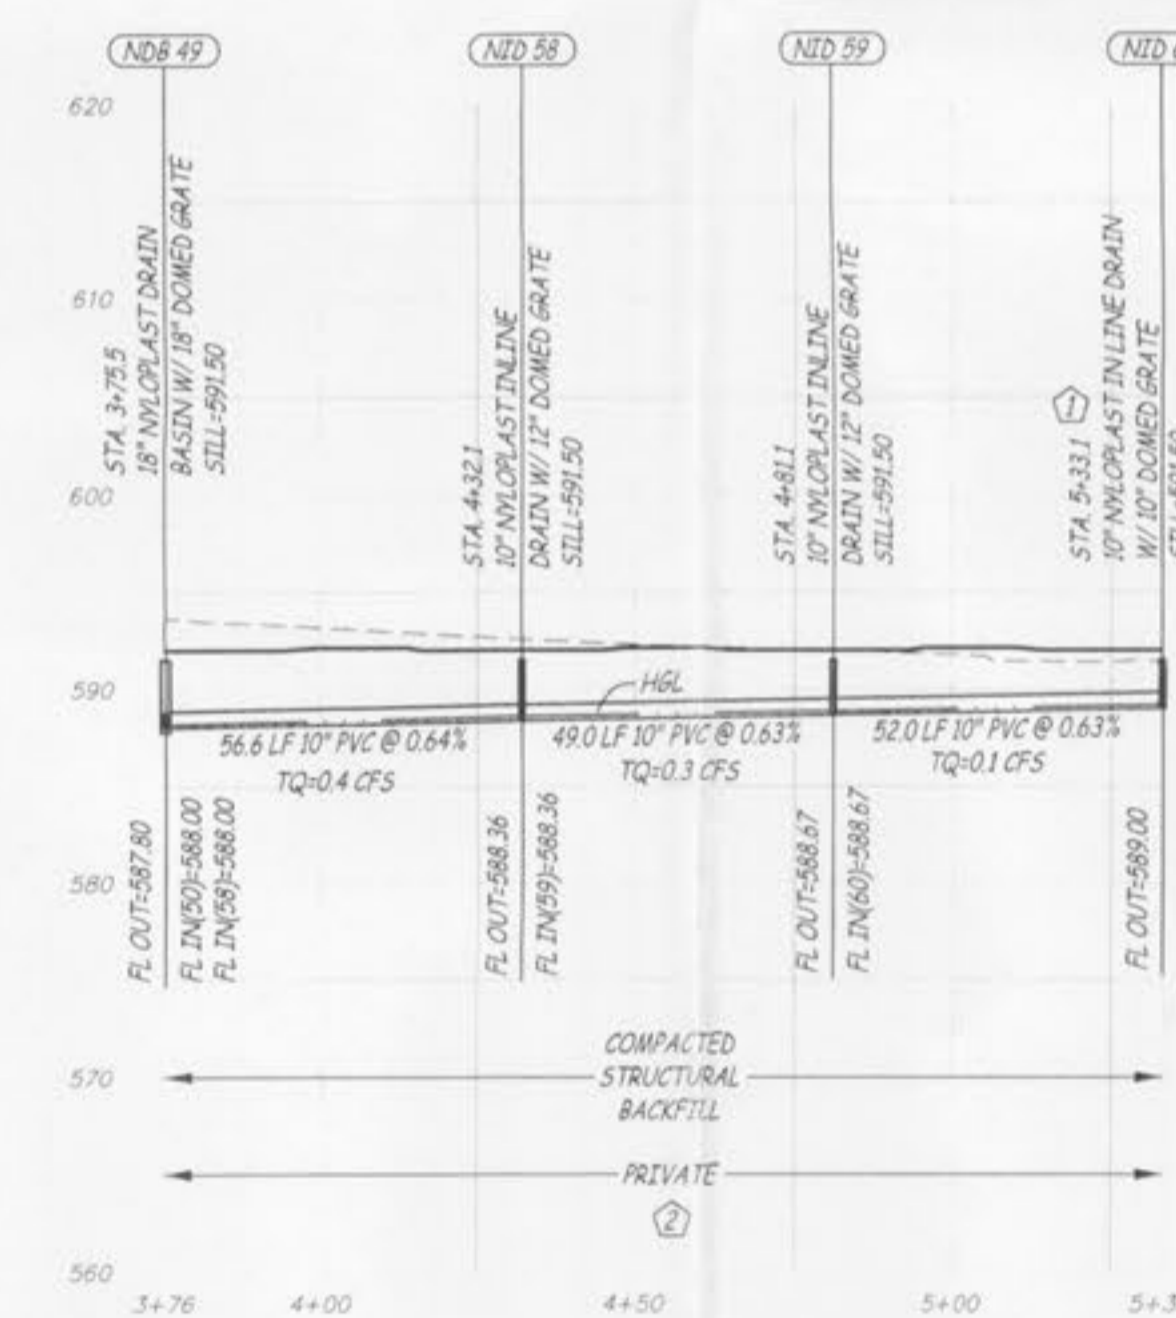

NDB 49 THRU NDB 60  
SCALE - HORIZ. 1" = 30'  
VERT. 1" = 10'

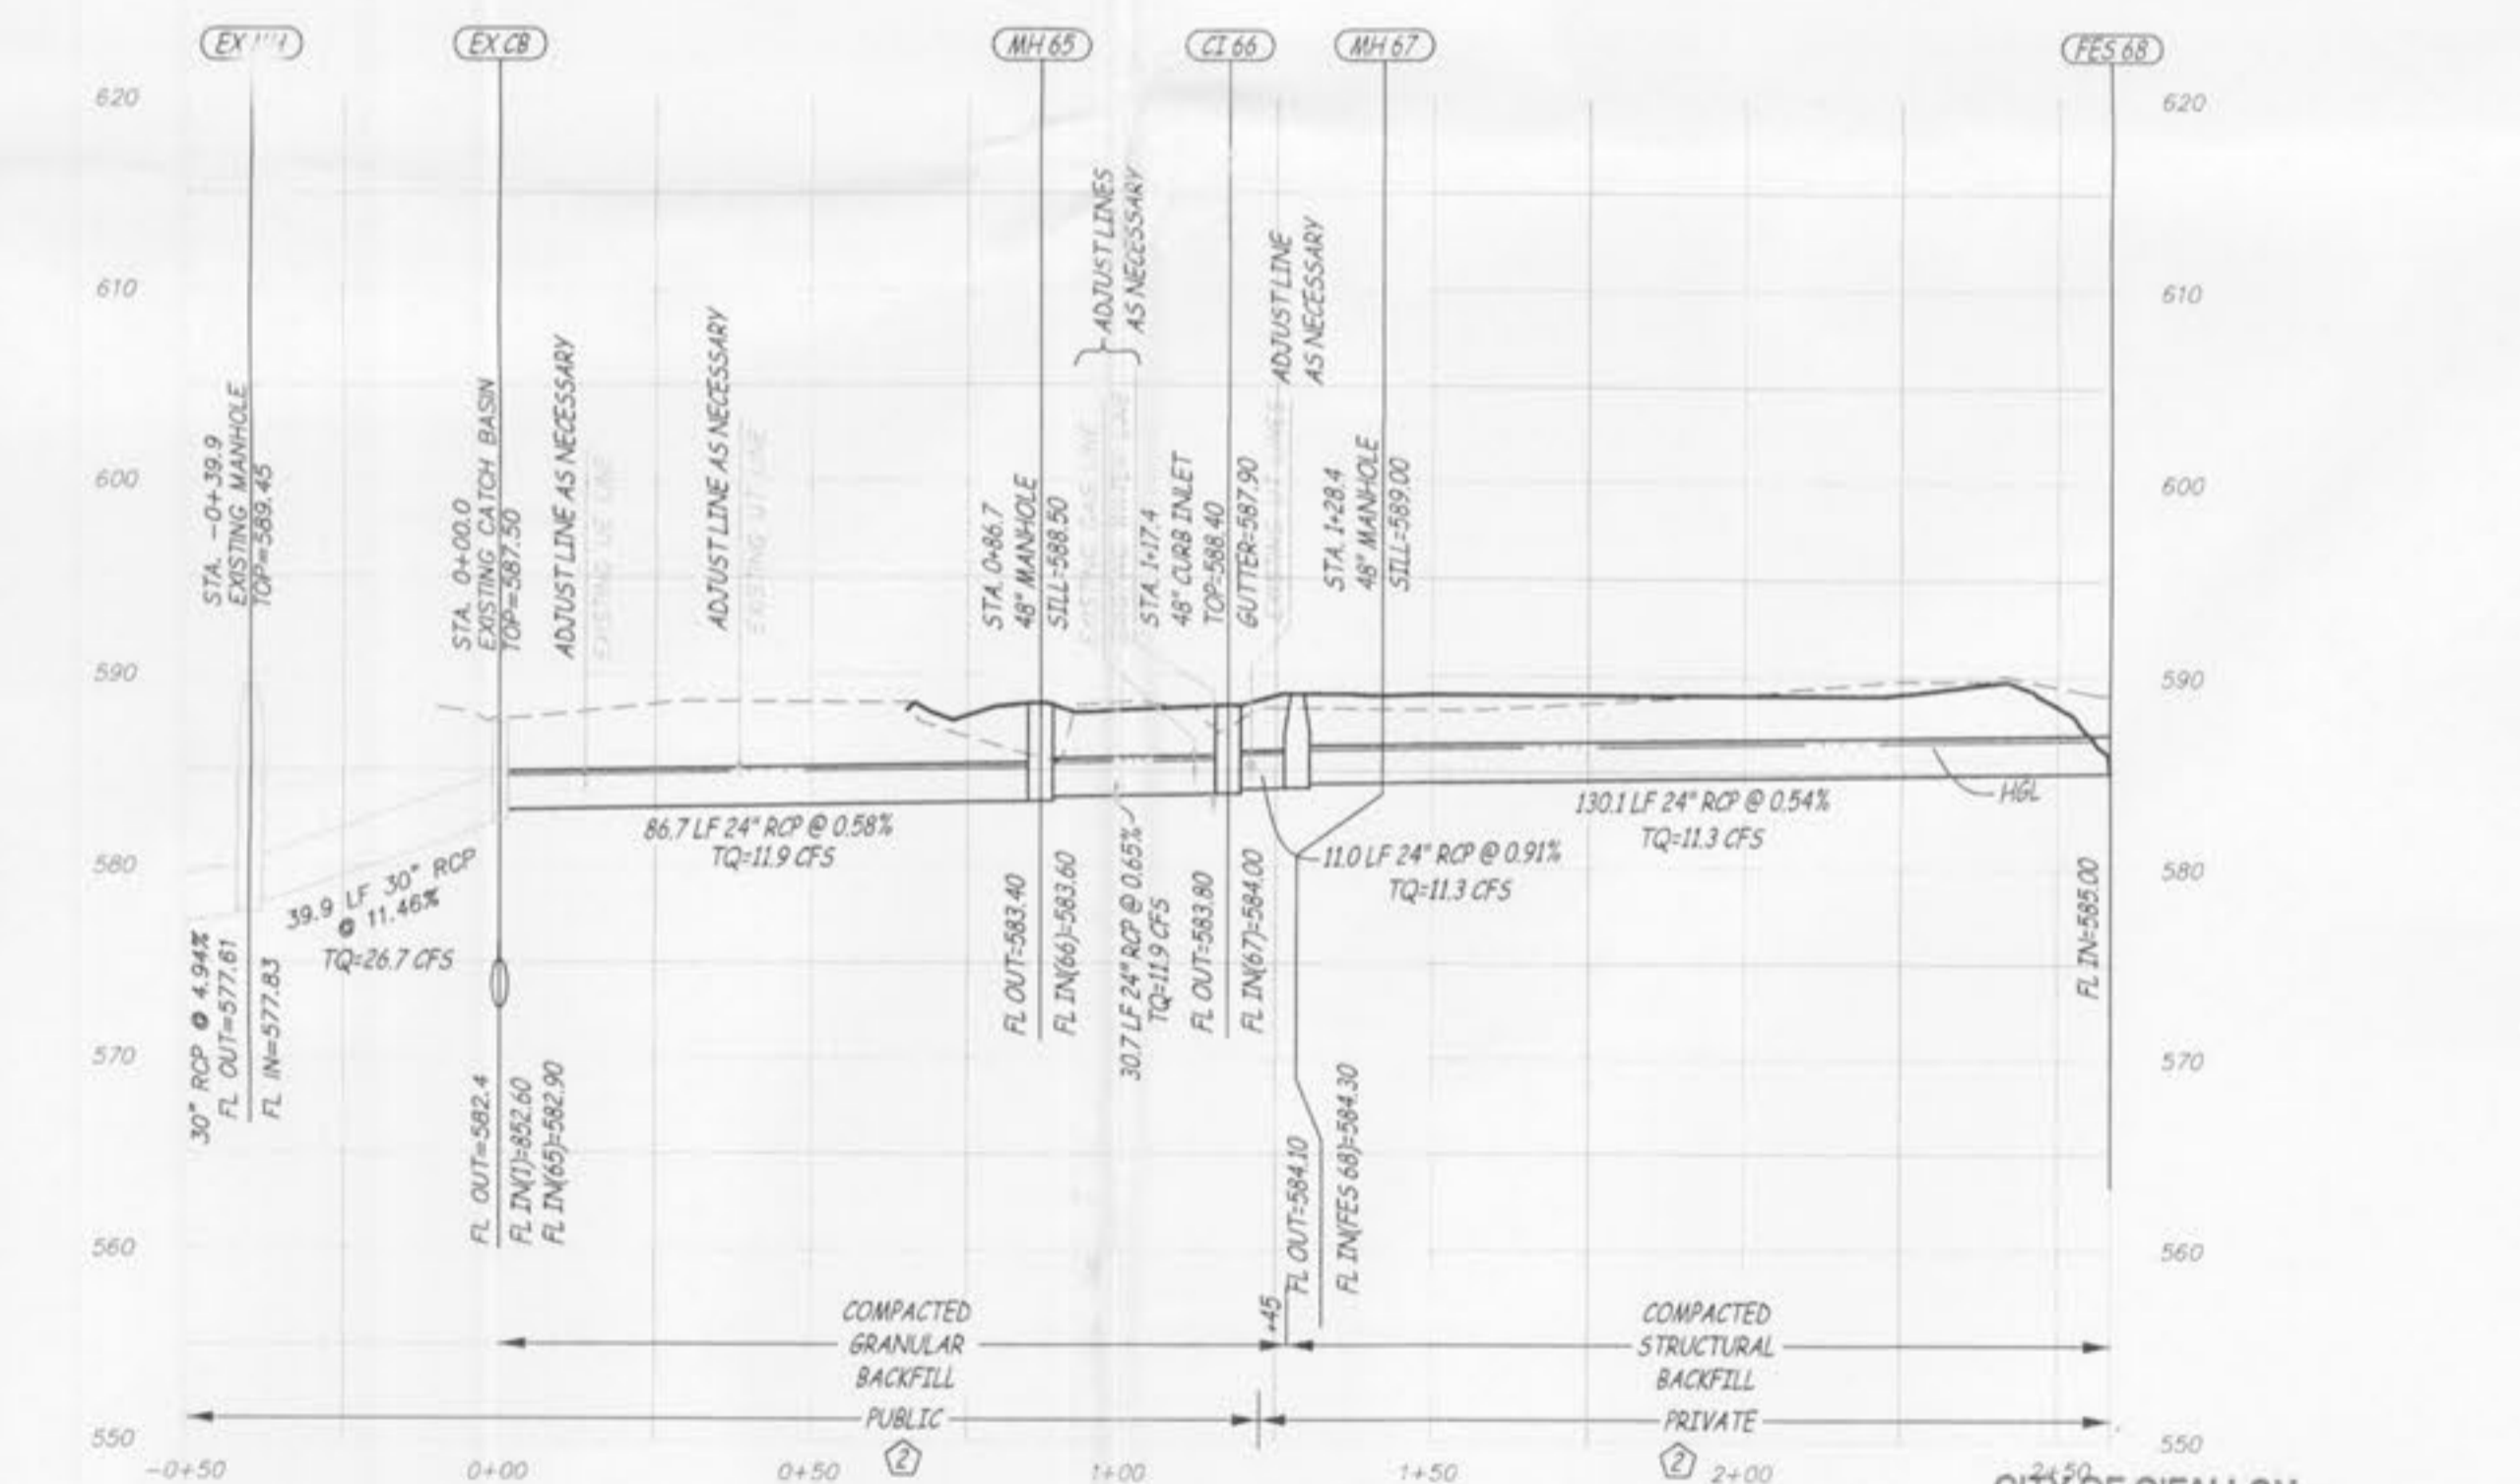


EXISTING MANHOLE THRU FES 68  
SCALE - HORIZ. 1" = 30'  
VERT. 1" = 10'

PROVIDE A MARKING ON THE STORM SEWER INLETS. THE CITY WILL ALLOW THE FOLLOWING MARKERS AND ADHESIVE PROCEDURES ONLY AS SHOWN IN THE TABLE BELOW OR AN APPROVED EQUAL BY ALMETEK INDUSTRIES. "PEEL AND STICK" ADHESIVE PADS WILL NOT BE ALLOWED.

MANUFACTURER	SIZE	ADHESIVE	STYLE	MESSAGE	WEBSITE
ACP INTERNATIONAL	3 7/8"	EPOXY	CRYSTAL CAP	"NO DUMPING DRAINS TO WATERWAYS" (SO-W-CC)	WWW.ACPINTERNATIONAL.COM
DAS MANUFACTURING, INC.	4"	EPOXY	STANDARD STYLE	"NO DUMPING DRAINS TO STREAM" (ASDS)	WWW.DASMANUFACTURING.COM

- REVISION NOTE:
- NDB 55 & 60 REVISED TO 10" NID
  - REVISED AT 65 THRU FES 68 TO EX MANHOLE THRU FES 68
  - ADDED "PUBLIC" AND/OR "PRIVATE" NOTES TO ALL STORM SEWER PROFILES
  - ADDED PIPE LABEL BETWEEN STRUCTURES MH 39 AND NDB 40

- NOTE:
- ENGINEERING SURVEYS & SERVICES SHALL APPROVE ALL INLET GRATE ALTERNATES.
  - HDPE PIPE IS TO BE N-12WT OR EQUAL AND TO MEET ASTM F1417 WATERTIGHT FIELD TEST.

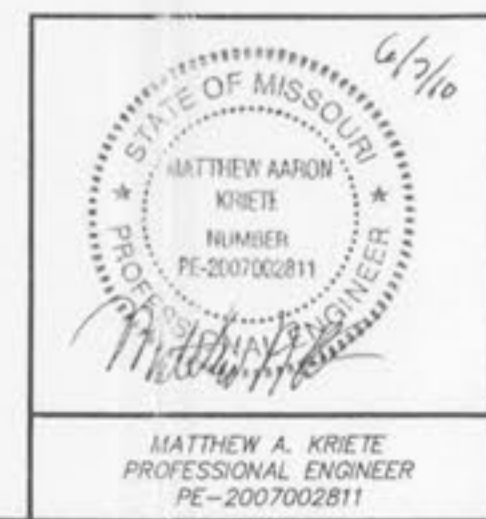

CITY OF O'FALLON  
COMMUNITY DEVELOPMENT DEPARTMENT  
ACCEPTED FOR CONSTRUCTION  
BY: *[Signature]* DATE: 6-22-10  
PROFESSIONAL ENGINEER'S SEAL  
INDICATES RESPONSIBILITY FOR DESIGN

PLANNING & DEVELOPMENT #1804.08 APPROVED AUGUST 6, 2009

STORM SEWER PROFILES

WOODBURY PLACE

ST. CHARLES COUNTY, O'FALLON, MISSOURI

Surveyed: -	Revised: 19 JAN. 2010
Drawn: JCB	3 MAR. 2010
Checked: TOC/MK	7 JUNE 2010

Scale: 1" = 30' HORIZ, 1" = 10' VERT

Date: DECEMBER 7, 2009

Job: 11354

Sheet: C108